

Read and Understand this Catalog

Please read and understand this catalog before purchasing the product. Please consult your OMRON representative if you have any questions or comments.

Warranty and Limitations of Liability

WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall the responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted. IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

Application Considerations

SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of the product in the customer's application or use of the product.

Take all necessary steps to determine the suitability of the product for the systems, machines, and equipment with which it will be used.

Know and observe all prohibitions of use applicable to this product.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

PROGRAMMABLE PRODUCTS

OMRON shall not be responsible for the user's programming of a programmable product, or any consequence thereof.

Disclaimers

CHANGE IN SPECIFICATIONS

Product specifications and accessories may be changed at any time based on improvements and other reasons. Consult with your OMRON representative at any time to confirm actual specifications of purchased product.

DIMENSIONS AND WEIGHTS

Dimensions and weights are nominal and are not to be used for manufacturing purposes, even when tolerances are shown.

PERFORMANCE DATA

Performance data given in this catalog is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of OMRON's test conditions, and the users must correlate it to actual application requirements. Actual performance is subject to the OMRON Warranty and Limitations of Liability.

Note: Do not use this document to operate the Unit.

Printed on 100%
Recycled Paper



OMRON Corporation

Control Devices Division H.Q.

Shiokoji Horikawa, Shimogyo-ku,
Kyoto, 600-8530 Japan
Tel: (81)75-344-7109
Fax: (81)75-344-7149

Regional Headquarters

OMRON EUROPE B.V.

Wegalaan 67-69, NL-2132 JD Hoofddorp
The Netherlands
Tel: (31)2356-81-300/
Fax: (31)2356-81-388

OMRON ELECTRONICS LLC

1 East Commerce Drive, Schaumburg,
IL 60173 U.S.A.
Tel: (1)847-843-7900/Fax: (1)847-843-8568


OMRON ASIA PACIFIC PTE. LTD.

83 Clemenceau Avenue,
#11-01, UE Square,
Singapore 239920
Tel: (65)6835-3011/Fax: (65)6835-2711

OMRON (CHINA) CO., LTD.

Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120 China
Tel: (86)21-5037-2222/Fax: (86)21-5037-2200

Authorized Distributor:

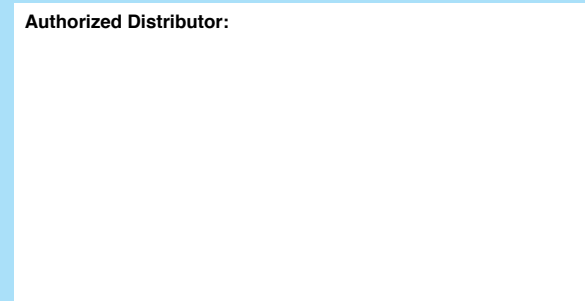

Note: Specifications subject to change without notice.

Cat. No. R128-E1-02
Printed in Japan
0106-2M

OMRON



SYSMAC CJ Series


Programmable Controllers

CJ1G-CPU□□P Loop-control CPU Unit

Unit Version 3.0 (Version Upgrade)

CJ1W-P□□□□ Process Input Units **NEW**


Fully Integrated Sequence and Loop Control
New Built-in Loop Controller

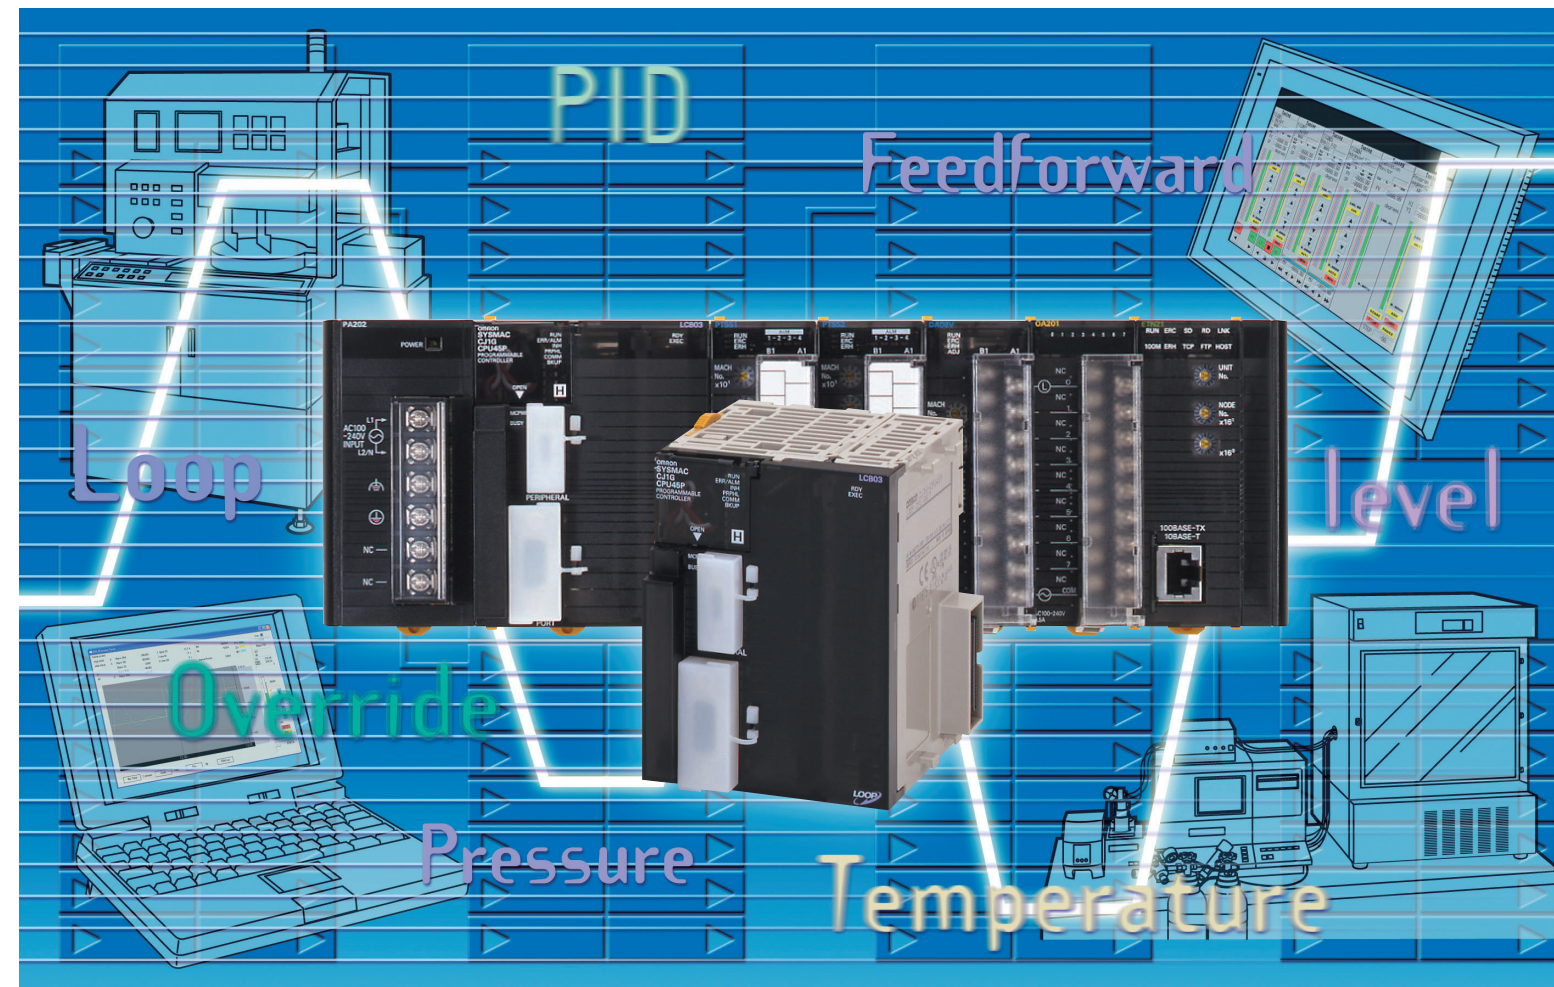

realizing


SMARTPROCESS
CONTROL

Advanced controller functions integrated with the same CJ-series functionality and high-speed capabilities

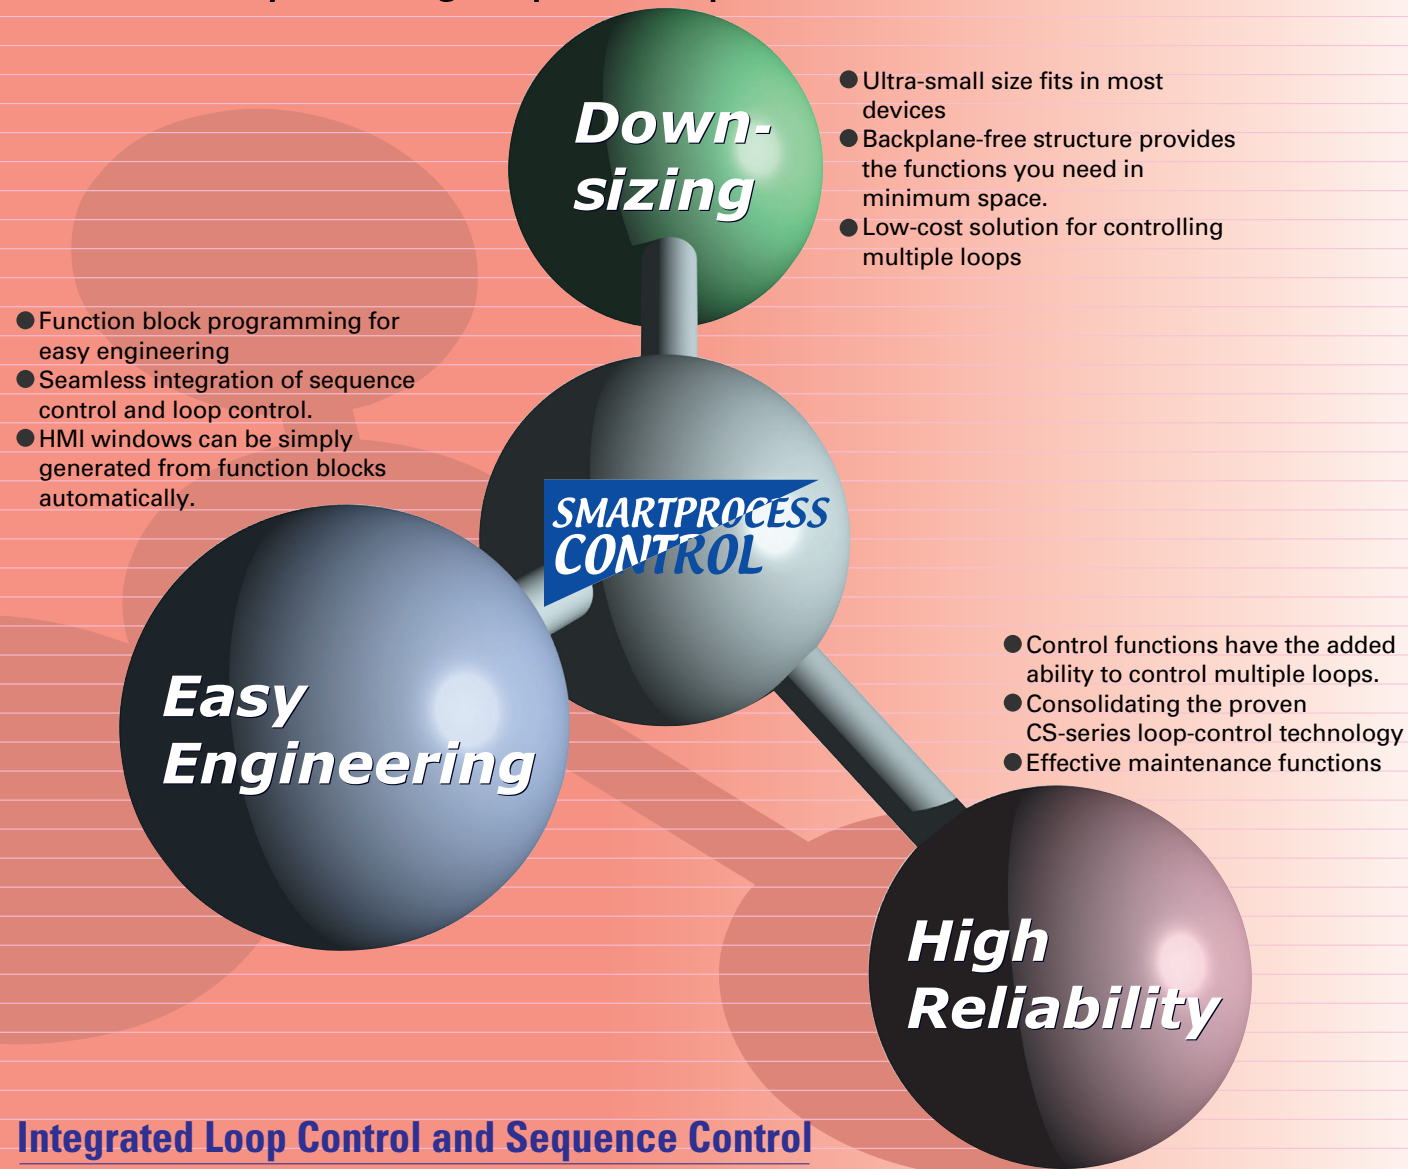

Integrated Loop Control and Sequence Control


An engine for controlling analog quantities (e.g., temperature, pressure, flowrate) is built into the CPU Unit together with the engine for executing sequence control, delivering high-speed sequence control and high-speed, advanced analog quantity control in a single Unit.

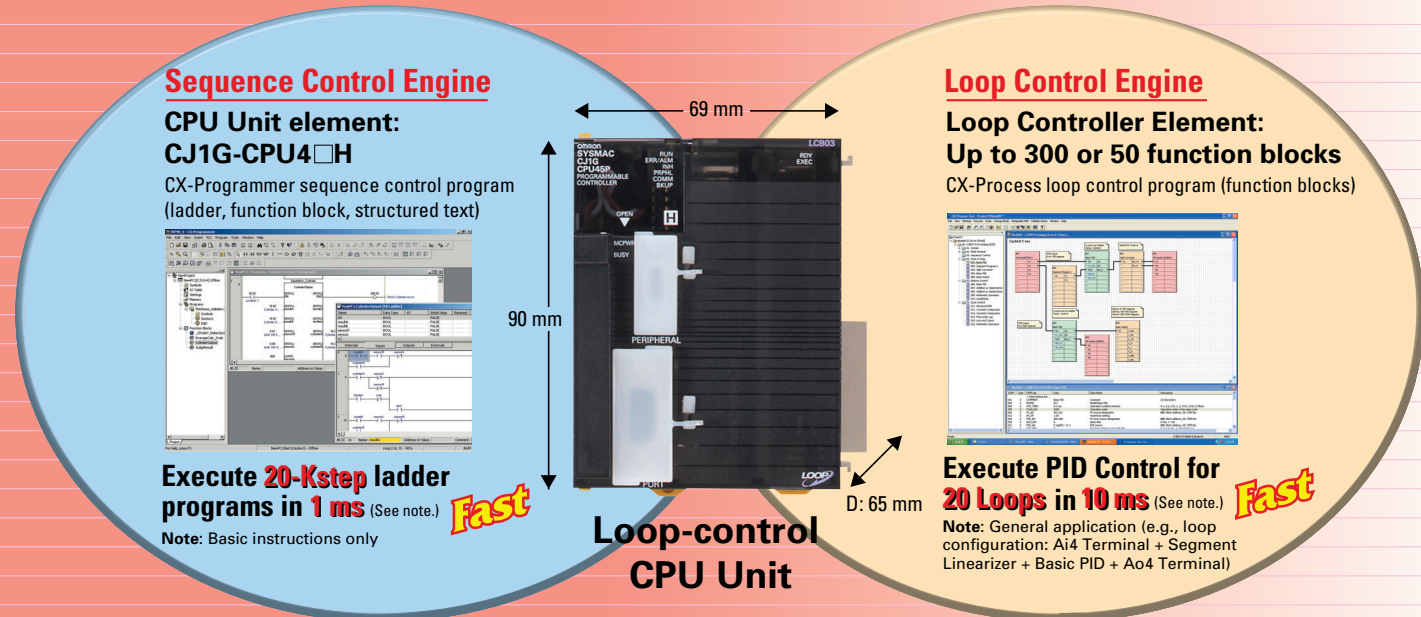

Down-sizing


Small Super compact: Only 90 mm High and 65 mm Deep, and Backplane-free structure enables flexible width design.

Compact PLC Aids Machine Downsizing by Fitting Just About Anywhere. Wide Array of I/O Units, Special I/O Units, and CPU Bus Units Are Available to Suit Your Application.

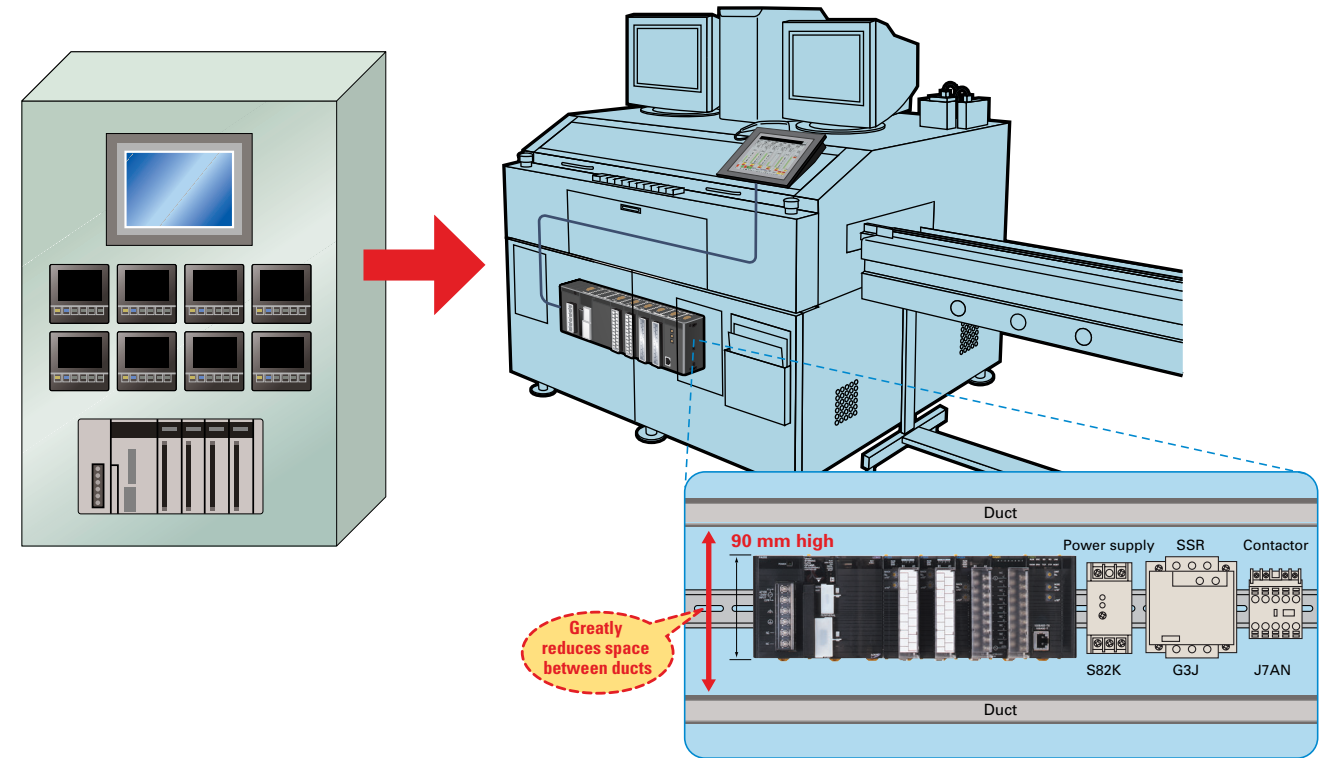


Fast High-speed sequence control functions can be used directly for high-speed, advanced loop control.

- **Sequence control:** Executes 20-Kstep ladder programs in 1 ms (with basic instructions only). PCMIX = 7.4 LD or OUT executed in 40 ns
- **Loop control:** Executes PID operations for 20 loops in up to 10 ms. This is a guide for general applications. (See note.)

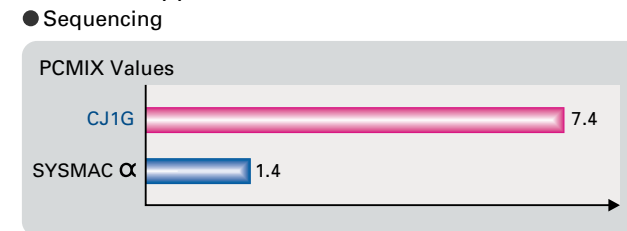


Note: Loop configuration: Ai4 Terminal + Segment Linearizer + Basic PID + Ao4 Terminal
The external I/O response time in the overall system refers to the conversion time.

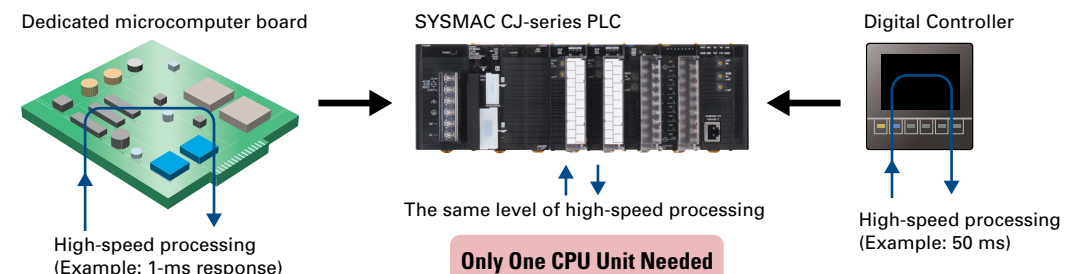


Easy Function blocks make loop-control programming easy. You can also create CX-Process Tool tuning windows to help adjust loops. Controller faceplates can be created automatically for touch panel displays.

- **Sequence control programs:** Standardize and simplify programs using structured programming. Special I/O Unit and CPU Bus Unit settings are easy with function blocks (using ladder programming language or structured text).
- **Loop control programs:** By combining function blocks, a wide array of control methods can be easily configured, from basic PID control used by Temperature Controllers to program, cascade, and feed-forward control.

● **Engineering Example: Program Control**

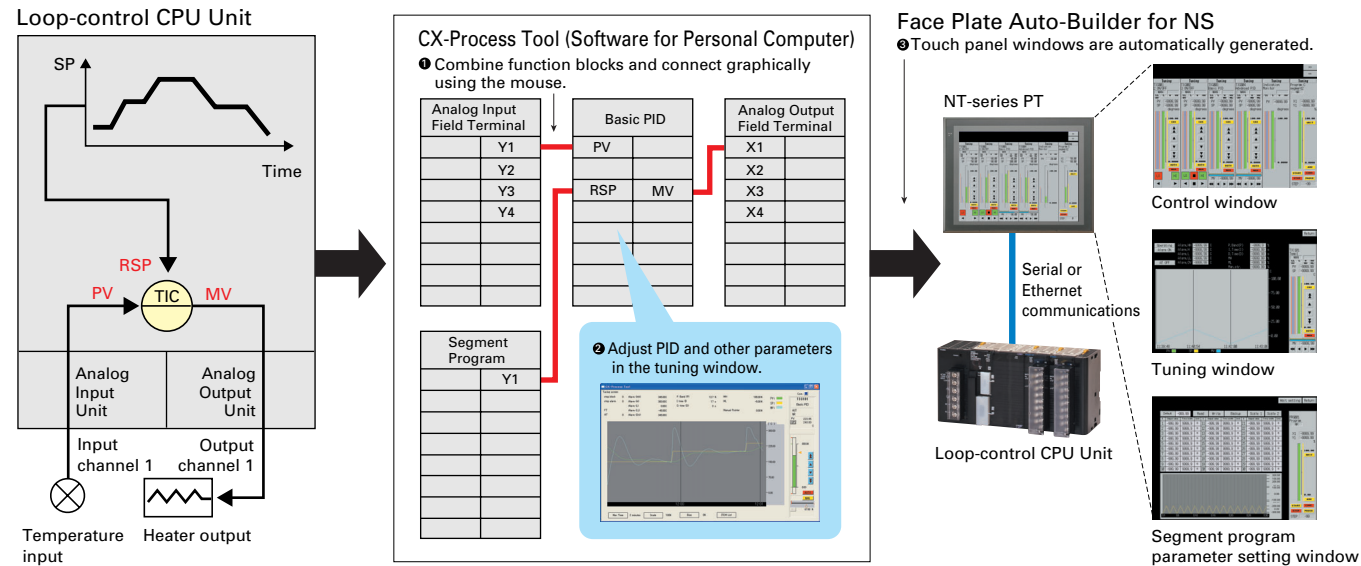


Expandability Lineup includes low-cost models that use up to 50 function blocks and models that allow up to 300 blocks designed for large-scale systems and complicated operations.

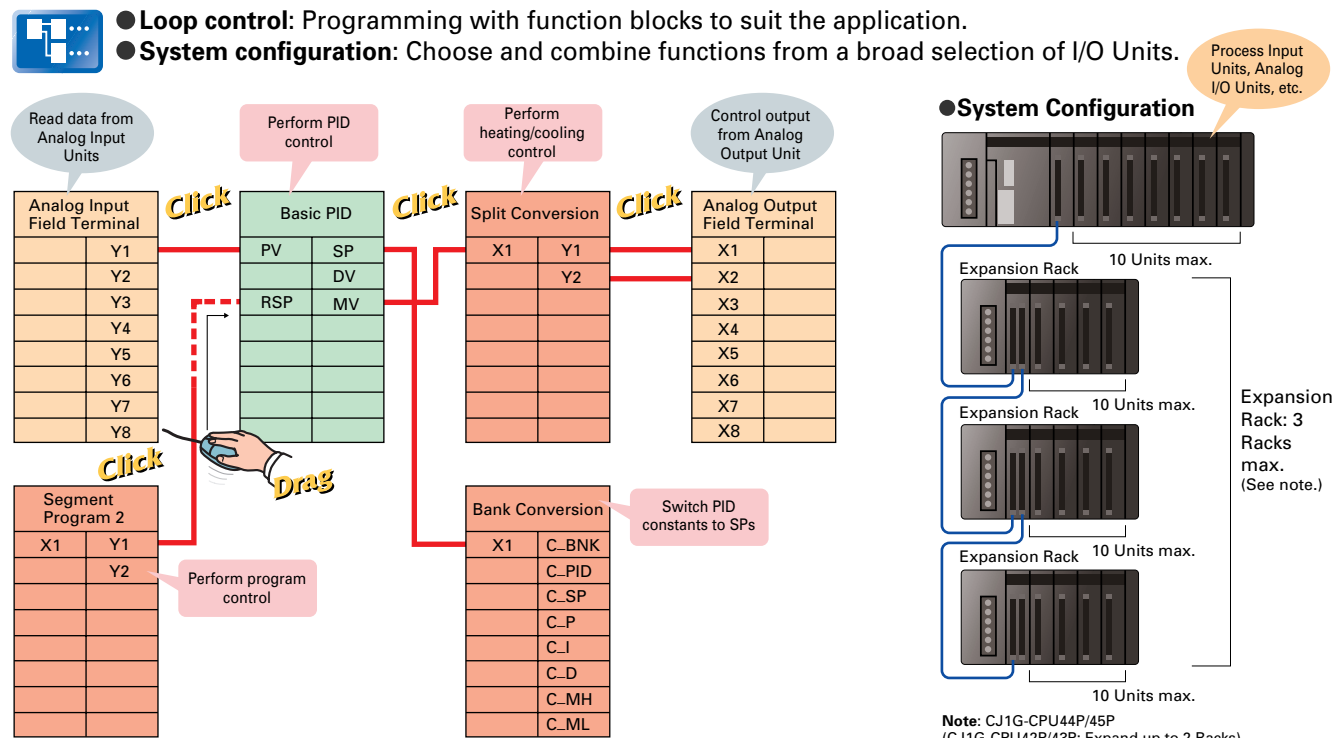

Maintenance Simply turn the DIP Switch ON/OFF to save or read the user program including function blocks using the Memory Card.

- Simple backup function enables backup, recovery, and comparison of all PLC data including the function block programs for the Loop Control Board using the Memory Card.
- Save tag settings, comments, annotations, and connection data created using the CX-Process Tool to either a Memory Card or a Loop-control CPU Unit. **Note:** Supported by unit version 3.0 or later.

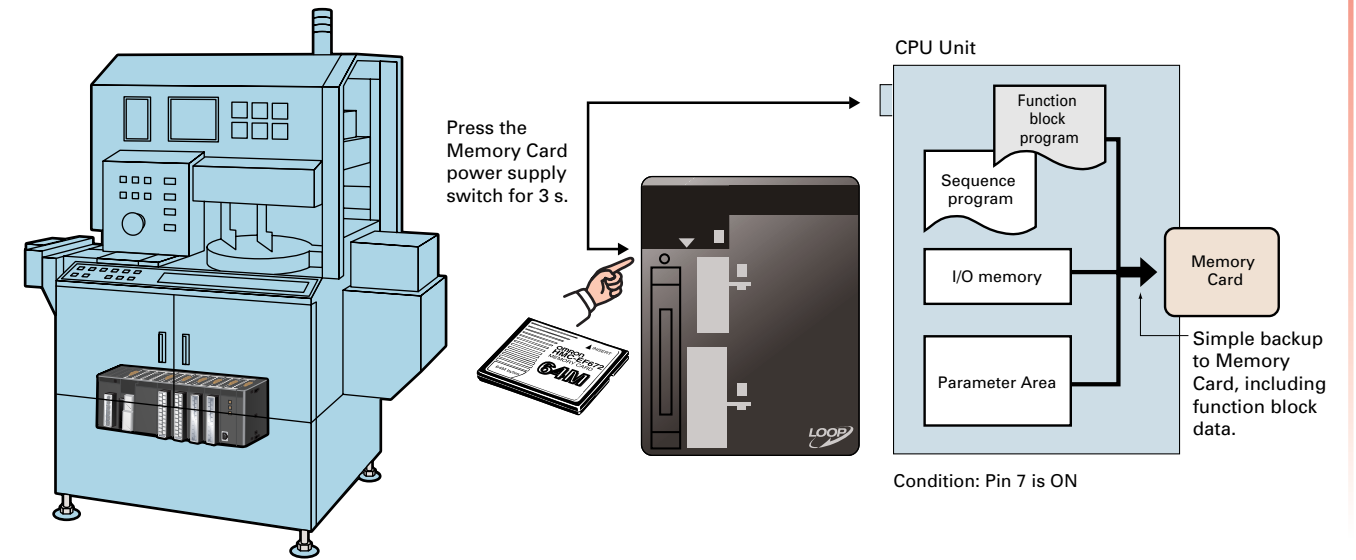

Results Consolidating OMRON's expertise in temperature and process control cultivated over many years to provide you with effortless solutions using proven algorithms.


- **Loop control:** Proven functionality of Temperature Controllers and CS-series Loop Control Boards (see note 1) in a compact size.

New Algorithm Further Enhances Control Stability Disturbance Overshoot Adjustment

This function restrains overshoot when a disturbance is generated, allowing faster stabilization.

[Example]


- Temperature drops when adding objects to a furnace
- Control disturbances when retooling

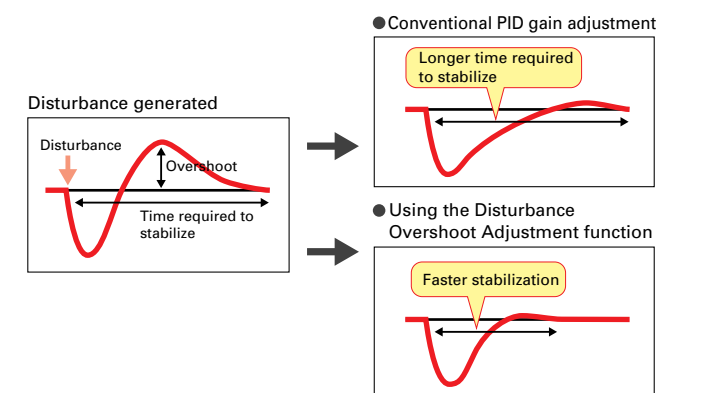

Optimum Tuning to Suit the Application Fine Tuning

Adjust PVs, SPs, and MVs while monitoring, and save data as CSV files from the software tuning window. Autotuning (AT) and fine-tuning functions can also be used for automatically calculating PID constants (see note 2).


- Note 1:** For details on CS-series Loop Control Boards, refer to the PLC-based Process Control Catalog (Cat. No. P051).
- Note 2:** Control can be fine-tuned by automatically tuning PID parameters using previous control parameters and three user-set requirements to execute fuzzy logic.

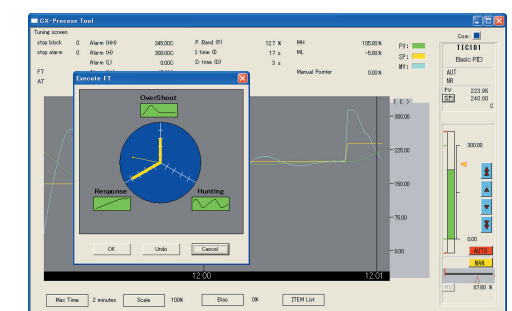

CS-Process Tool Tuning Window

Applications

The Loop-control CPU Unit Provides You with Solutions for the Complex and Advanced Functions Demanded by Control Devices in an Increasingly Diverse Range of Equipment.

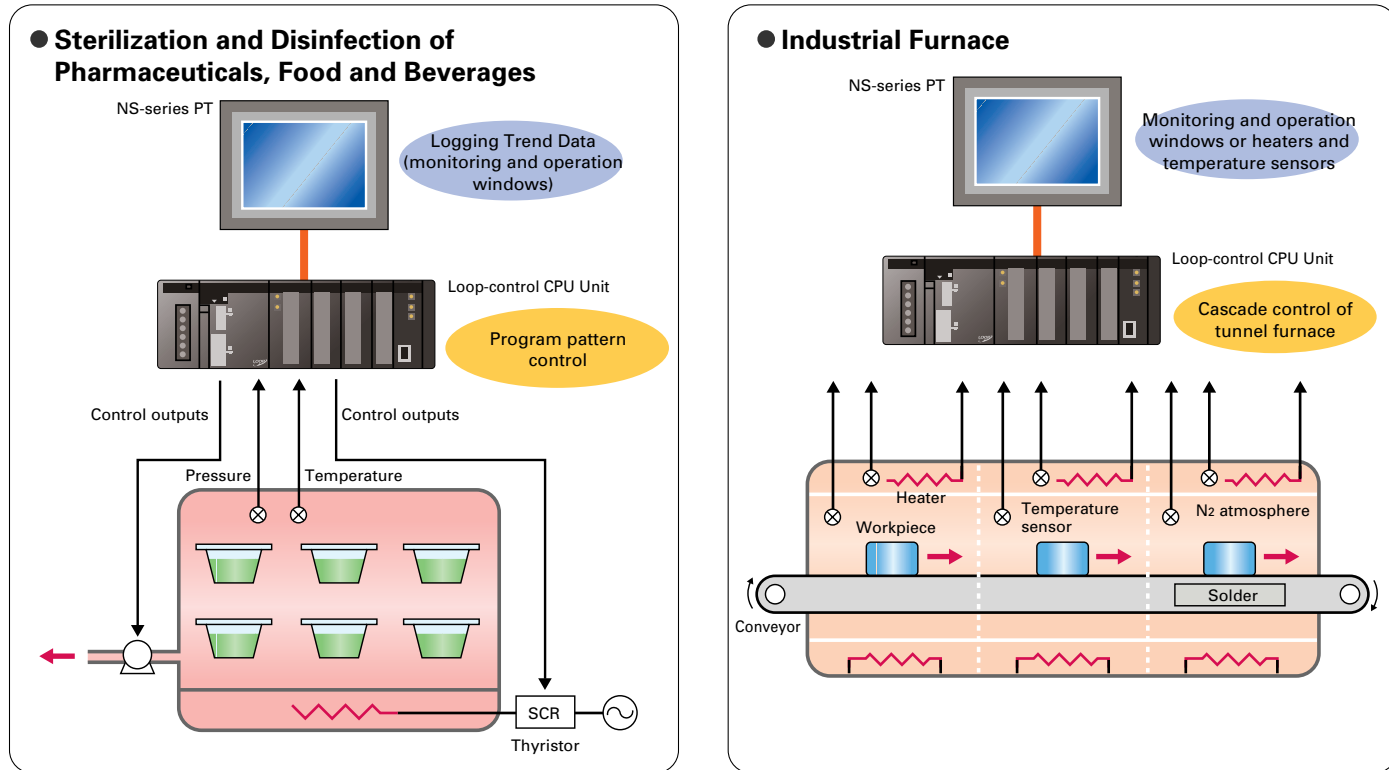

Providing Solutions to Other Problems

Electrical parts equipment requiring high-speed temperature control for higher precision and improved tact time.

Fermentation equipment requiring temperature, pressure, flowrate, and pH control.

Diffusion furnaces that perform cascade control of heater temperatures and internal chamber temperatures.


Food machines, semi-conductor devices and other machines requiring **multi-point temperature control.**

Testing devices that frequently change setting conditions and program settings.

Loop Control Machines and Product Variations


Model Selection

Compact CJ-series Loop-control CPU units are ideal for equipment with built-in applications. CS-series and CS1D models designed for duplex systems are also available for processing equipment that requires high reliability.

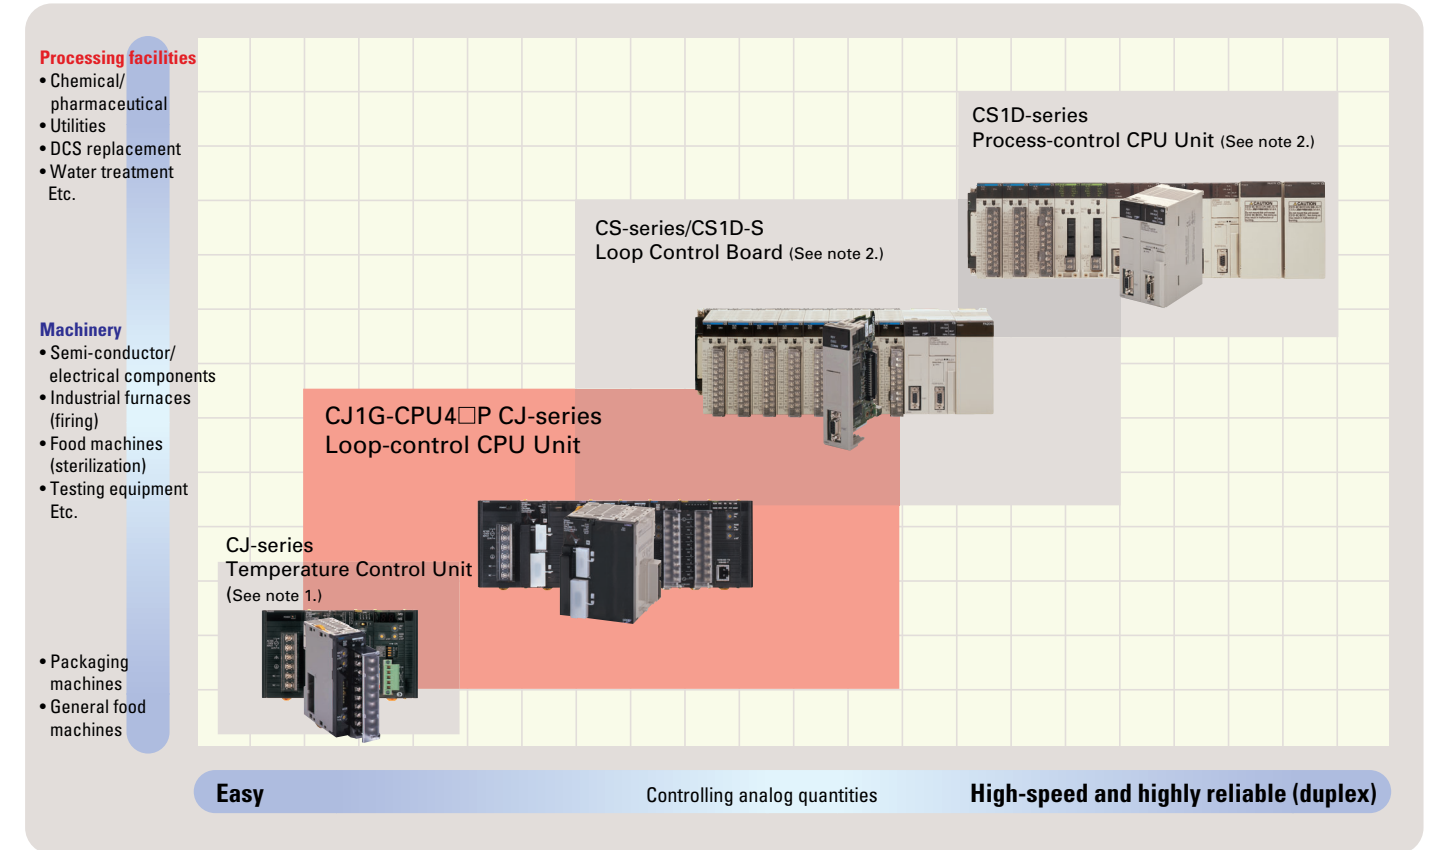

Note 1: The Temperature Control Unit integrates control and I/O for either 2 loops or 4 loops. Temperature control is achieved simply by setting parameters. (CX-Process cannot be used.)
Note 2: For details on CS-series Loop Control Boards and Process-control CPU Units, refer to the PLC-based Process Control Catalog (Cat. No. P051).

System Configuration Example

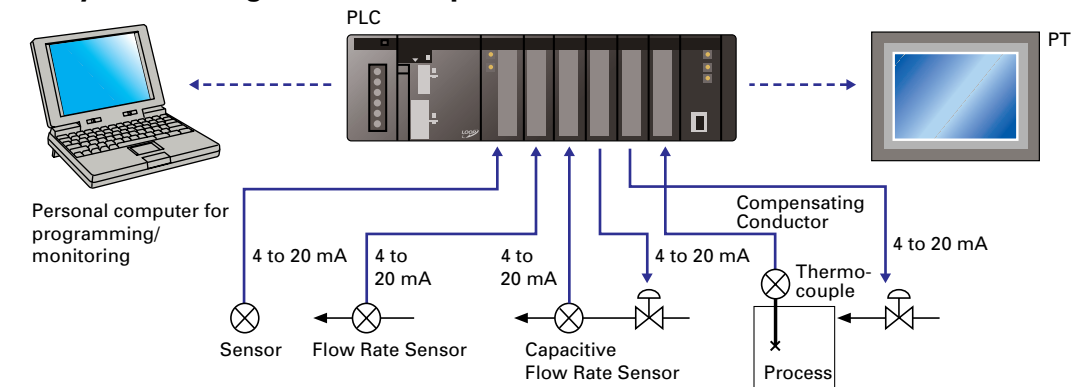

Example of Peripheral Devices

Temperature Sensors	Input	Control	Output	
E52 Thermocouples Platinum-resistance Thermometers	CJ1W-P□□□ Analog Process Input Unit CJ1W-AD□□□ Analog Input Unit	CJ1G-CPU□□P Loop-control CPU Unit	CJ1W-DA□□□ Analog Output Unit (linear output)	• Position Control G3PX Power Controller
Analog quantities (e.g., temperature, flowrate, concentration)			CJ1W-OD□□□ Transistor Output Unit (pulse output)	• Cycle Control G32A-EA + G3PA
ES1/ES1B Infrared Thermosensors Flow Rate Sensors, Displacement Sensors, Signal Converters, etc.			CJ1W-OC□□□ Relay Output Unit	• SSR G3PA/B/C, G3NA, etc.
			RS-485 communications: Built-in serial port on CPU Unit CJ1W-SCU□1-V1	• ON/OFF Control
				• Optimum Cycle Control G3ZA

SYMAC CJ Series

Peripheral Devices

Input Devices

E52-series Temperature Controllers

Plenty of Variation to Suit an Extensive Range of Applications

- Select from a variety of choices in number of elements, shape, protective tubing length, and terminal type.
- Economical models and special models are available as well as general-purpose models. Select from a diverse range of models to suit the application: Models for high temperatures, metal patterns, surface measurement, and room temperatures, waterproof and anti-corrosive models, models for moving parts, and models with double elements.

Model Structure

E52-①②③ D=④ ⑤ M

① Element type ④ Protective tubing model
 ② Protective tubing length ⑤ Lead wire length
 ③ Terminal type

Example: **E52-CA185A D:3.2 2M**



ES1/ES1B-series Infrared Thermosensors

Hygienic temperature measurement without damaging the workpiece. Ideal for workpieces on conveyors or other applications in which contact measurement is difficult.

- ES1 Series: Designed for high-precision, small-spot, high-temperature measurements.
- Two types of small spot: 3-mm dia. and 8-mm dia.
- High-precision and high-speed measurement with a repeatability of $\pm 0.5^\circ\text{C}$ and response speed of 0.4 s (95%).
- Models are available for medium (-500 to 500°C), mid-low (-50 to 500°C), and high (0 to 1000°C) temperature ranges.



Output Devices

G3PX-series Power Controllers

Single-phase Power Controller for phase control systems requiring precision temperature control. Models with base up and soft start functions also available.

Model Structure

G3PX-□□□□-CT□ Example: **G3PX-220EUN-CT03**

① Load power supply voltage ③ Phase ⑤ Current transformer types
 2: 200/220 V D: Three-phase 03: 30-cm lead
 ② Load current ④ Function classification 10: 1-m lead
 20: 20 A UN: Single function
 40: 40 A H: Heater burnout detection
 60: 60 A HN: Multiple heater burnout detection
 C: Constant current

- * Three-phase Power Controllers are also available.



G3PA/B/C Power Solid-state Relay

G3PA New Power Solid-state Relay

- Dielectric strength of 4,000 VAC with a super slim profile and built-in heat sink
- Mount either using screws or DIN Track.

G3PB Three-phase Solid-state Relay (Contactor)

- Upgraded heat sink saves space and labor costs.
- 480-VAC models for a broad range of applications.

G3PC SSR with Failure Detection Function

- Detects SSR failure, which is difficult to identify in heater temperature control, and outputs alarm signals simultaneously.
- Contributing to safe design and improved maintenance of heater control systems.

For details, refer to the Temperature Controllers Selection Guide (Cat. No. Y101).




New Products

G3ZA Multi-channel Power Controller Catalog No.: J147

Multi-channel Power Controller with Zero-cross SSRs. Receives MVs from the PLC Using RS-485 Serial Communications (via FB* or Protocol Macro**), and Controls the Heater Power with High Precision Using the SSR.

- **Optimum Cycle Control for High-precision Control with Low Noise**
 Delay control: Energy-efficient, enabling equipment downsizing by using the peak current cut method, which delays the output timing between channels.
- Control variable conversion: Enables processing and output of input control quantities using the internal gradient and internal offset settings.

- **Smaller than a Normal Power Controller**
 Same height as G3PA and G3PB, enabling smaller panels and saving space. One Controller can control up to 8 SSRs.
- Models with 8 channels (control points) or with 4 channels and heater burnout detection are available.
- RS-485 communications to set manipulated variables and heater burnout detection.


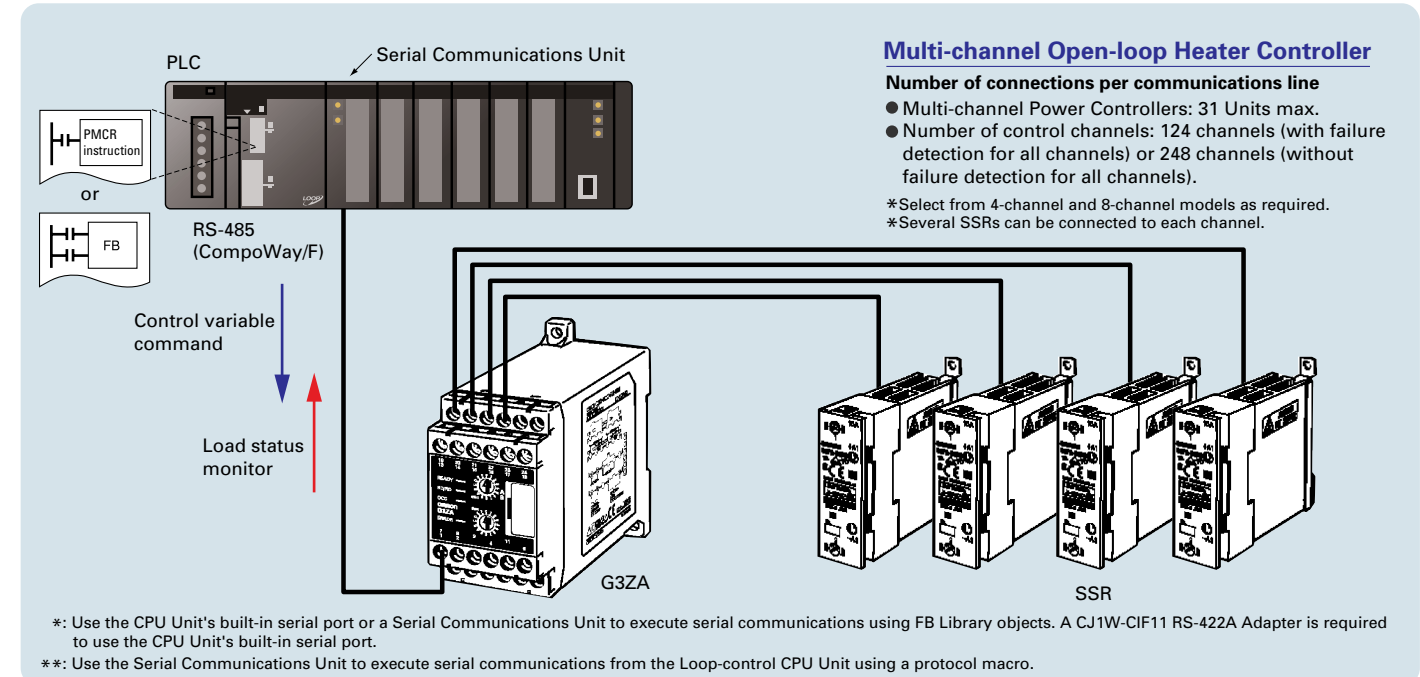


Storage and Processing Unit Catalog No.: V301

CJ1W-SPU01 SYSMAC SPU Unit

The SPU Unit can read the PLC's I/O memory using specific data collection methods, and record the data in CSV files.

- **Record Production Histories, Inspection Data, and Process Data**
- Data can be collected by environment-resistant PLC Units, without using a personal computer.
- Because the Unit has a direct bus connection to the PLC and does not require communications, it can collect large quantities of data at high speed.
- Data can be collected by means of a simple settings, with no need to alter the ladder program.
- **Collecting Data on Equipment Operation to Analyze Errors and Detect Operating Trends**
- Data collection settings can be changed and collection can be restarted without stopping the PLC.
- Files can be created in the desired data structure for only the required data in the PLC.
- Sampling Mode can be selected for high-speed, detailed sampling, or Data Storage Mode can be selected for data collection at specified times or when a specified events occur.

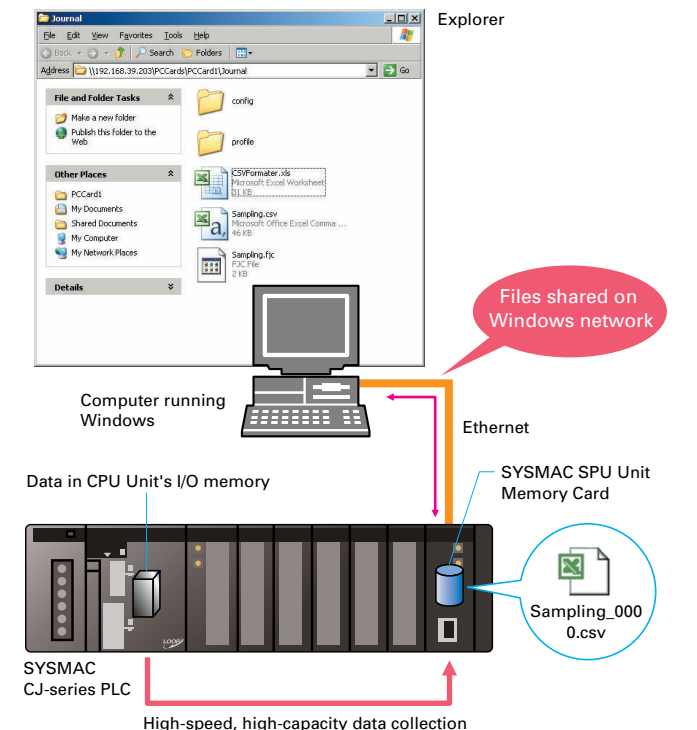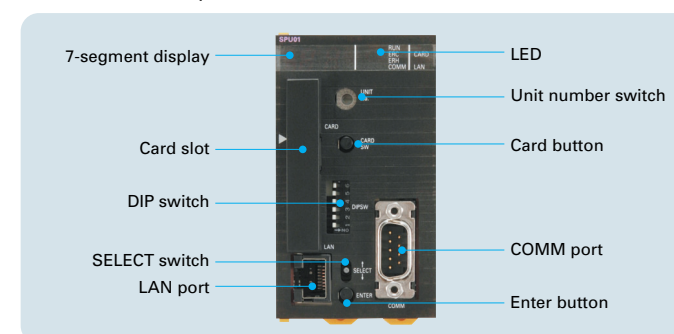

Loop-control CPU Units

Loop-control CPU Units

Model	CPU Unit element				Loop Controller element	
	I/O bit capacity	Program capacity	Data memory capacity	Programming software	Number of function blocks	Programming software
CJ1G-CPU45P	1,280 bits (Up to 3 Expansion Racks)	60 Ksteps	128 K words (DM: 32 K words, EM: 32 K words × 3 banks)	CX-Programmer, CX-Simulator, etc.	300 blocks	CX-Process
CJ1G-CPU44P		30 Ksteps				
CJ1G-CPU43P	960 bits (Up to 2 Expansion Racks)	20 Ksteps	64 K words (DM: 32 K words, EM: 32 K words × 1 bank)			
CJ1G-CPU42P		10 Ksteps			50 blocks	

Loop Controller Element Specifications

Item	Specification	
Name	Loop-control CPU Unit	
Model Number	CJ1G-CPU□□P	
Applicable PLCs	CJ-series PLCs	
Area for data exchange with CPU Unit	CPU Unit's Auxiliary Area <ul style="list-style-type: none"> Loop Controller element-to-CPU Unit element: Run Status Flag, PV Error Input Flag, MV Error Input Flag, Execution Error Flag, Function Block Database (RAM) Error Flag, Automatic Cold Start Execution Flag, Backup during Operation Flag, Function Block Changed Flag, etc. CPU Unit element-to-Loop Controller element: Start Mode at Power ON: Hot/Cold Start bit. 	
	User allocations in I/O Memory	User link tables are used to allocate function block ITEM data in any part of I/O memory in the CPU Unit. (CIO, Work, Holding, or DM Areas, or EM Area bank 0)
	Allocations for all data	HMI function used to allocate function block ITEM data for Control, Operation, External Controller, and System Common blocks in the specified bank of the EM Area in the CPU Unit.
Settings	None	
Indicators	Two LED indicators: RUN and ready	
Super capacitor backup data	All function block data (including sequence tables, step ladder program commands), stored error log data	
Super capacitor backup time	5 minutes at 25°C	
Data stored in flash memory	Function block data	
Backup from RAM to flash memory	Executed from CX-Process Tool (as required).	
Recovery from flash memory to RAM	Automatically transferred when power to CPU Unit is turned ON if startup mode is set for a cold start, or executed from CX-Process Tool (as required).	
Influence on CPU Unit cycle time	0.8 ms max. (depends on function block data contents)	
Current consumption (supplied from Power Supply Unit)	1.06 A for 5 VDC (current consumption for Loop-control CPU Unit including CPU Unit element and Loop Controller element) Note: Increased by 150 mA when NT-AL001 Link Adapter is used.	

Loop Controller Element Specifications

Item			Specifications																		
Model			CJ1G-CPU42P	CJ1G-CPU43/44/45P																	
Operation method			Function block method																		
Loop Controller element			LCB01	LCB03																	
Function block analog operations	Control and operation blocks	PID and other control functions, square root operation, time operations, pulse train operation, and other operation functions for various processes.	50 blocks max.	300 blocks max.																	
Sequence control	Step ladder program blocks	Logic sequence and step sequence functions	20 blocks max. 2,000 commands total 100 commands max. per block Separable into 100 steps max.	200 blocks max. 4,000 commands total 100 commands max. per block Separable into 100 steps max.																	
I/O blocks	Field terminal blocks	Analog I/O function with Analog I/O Unit, contact I/O function with Basic I/O Unit	30 blocks max.	CJ1G-CPU43P: 30 blocks max. CJ1G-CPU44/45P: 40 blocks max.																	
	User link tables	Analog data I/O and contact data I/O function for CPU Unit	2,400 data items max.																		
	HMI function	I/O function for the specified bank of the EM Area in the CPU Unit for function block ITEM data used for Control, Operation, External Controller, and System Common blocks for the HMI function.	Allocated 1 EM Area bank Operation and Control blocks: 50 blocks max. × 20 send/receive words System Common blocks: 20 send/receive words	Allocated 1 EM Area bank Operation and Control blocks: 300 blocks max. × 20 send/receive words System Common blocks: 20 send/receive words																	
	System Common block	System common operation cycle setting, run/stop command, load rate monitor, etc.	Single block																		
Method for creating and transferring function blocks			Created using CX-Process Tool (purchased separately) and transferred to Loop Controller.																		
External I/O response time			The time from external input of analog signals up to external output of analog signals on a single control loop depends on the function block's operation cycle and the CPU Unit's cycle time.																		
Operation cycle			0.01, 0.02, 0.05, 0.1, 0.2, 0.5, 1, or 2 s (default: 1 s) (See note.) Can be set for each function block. Note: 0.01, 0.02, and 0.05 s cannot be set for some blocks.																		
Internal operation	Number of control loops		<ul style="list-style-type: none"> The maximum number of loops that can be used if the LCB load rate is 80% for a standard applications (e.g., with each loop consisting of one Ai4 Terminal, Segment Linearizer, Basic PID, and A04 terminal) is shown in the following table. <table border="1" style="margin-left: 20px;"> <thead> <tr> <th>Operation cycle</th> <th>Maximum number of loops</th> <th>Operation cycle</th> <th>Maximum number of loops</th> </tr> </thead> <tbody> <tr> <td>0.01 s</td> <td>20 loops</td> <td>0.2 s</td> <td rowspan="4">150 loops (See note.)</td> </tr> <tr> <td>0.02 s</td> <td>35 loops (see note)</td> <td>0.5 s</td> </tr> <tr> <td>0.05 s</td> <td>70 loops (see note)</td> <td>1 s</td> </tr> <tr> <td>0.1 s</td> <td>100 loops (see note)</td> <td>2 s</td> </tr> </tbody> </table> <p>Note: Loop Controller element LCB01: 25 loops max.</p>		Operation cycle	Maximum number of loops	Operation cycle	Maximum number of loops	0.01 s	20 loops	0.2 s	150 loops (See note.)	0.02 s	35 loops (see note)	0.5 s	0.05 s	70 loops (see note)	1 s	0.1 s	100 loops (see note)	2 s
Operation cycle	Maximum number of loops	Operation cycle	Maximum number of loops																		
0.01 s	20 loops	0.2 s	150 loops (See note.)																		
0.02 s	35 loops (see note)	0.5 s																			
0.05 s	70 loops (see note)	1 s																			
0.1 s	100 loops (see note)	2 s																			
Control method	PID control method	PID with 2 degrees of freedom																			
	Control combinations	Any of the following function blocks can be combined: Basic PID control, cascade control, feed-forward control, sample PI control, Smith dead time compensation control, PID control with differential gap, override control, program control, time-proportional control, etc.																			
Alarms	PID block internal alarms	4 PV alarms (upper upper-limit, upper limit, lower limit, lower lower-limit) and 1 deviation alarm per PID block																			
	Alarm blocks	High/low alarm blocks, deviation alarm blocks																			

List of Function Blocks

System Common Block

Type	Block Name	Function
---	System Common	Makes settings common to all function blocks and outputs signals for the system.

Operation Blocks

Type	Block Name	Function	
Alarm/Signal restrictions/ Hold	High/Low Alarm (See note.)	Provides the alarm contact outputs for the high and low limits of single analog signals.	
	Deviation Alarm (See note.)	Provides the alarm contact outputs for the deviation of two analog signals.	
	Rate-of-change Operation and Alarm (See note.)	Provides the alarm contact outputs for the high and low limits of rate-of-change operation when the analog signal rate-of-change is output.	
	High/Low Limit (See note.)	Limits the high and low limits of single analog signals.	
	Deviation Limit (See note.)	Calculates the deviation between two analog signals, and limits the deviation within that range.	
	Analog Signal Hold (See note.)	Holds the maximum, minimum or instantaneous value of single analog signals.	
Arithmetic	Addition or Subtraction (See note.)	Performs addition/subtraction with gain and bias on up to 4 analog signals.	
	Multiplication (See note.)	Performs multiplication with gain and bias on up to 2 analog signals.	
	Division (See note.)	Performs division with gain and bias on up to 2 analog signals.	
	Arithmetic Operation (See note.)	Performs various math operation (trigonometric, logarithmic, etc.) on floating-point decimal values converted (to industrial units) from up to 8 analog inputs.	
	Range Conversion (See note.)	Easily converts up to 8 analog signals simply by inputting the 0% and 100% input values and 0% and 100% output values.	
Functions	Square Root (See note.)	Performs square root extraction (with low end cut-out) on single analog signals.	
	Absolute Value (See note.)	Outputs the absolute value of single analog signals.	
	Non-linear Gain (Dead Band) (See note.)	Performs non-linear (3 gain values) operation on single analog signals. Analog signals can also set as a dead band (with different gap).	
	Low-end Cutout (See note.)	Sets output to zero close to the zero point of single analog signals.	
	Segment Linearizer (See note.)	Converts single analog signals to 15 segments before the signals are output.	
	Temperature and Pressure Correction (See note.)	Performs temperature and pressure correction.	
	Time Function	First-order Lag (See note.)	Performs first-order lag operation on single analog signals.
		Rate-of-change Limit (See note.)	Performs rate-of-change restriction on single analog signals.
		Moving Average (See note.)	Performs moving average operation on single analog signals.
Lead/Delay (See note.)		Performs lead/delay operation on single analog signals.	
Dead Time (See note.)		Performs dead time and first-order lag operations on single analog signals.	
Dead Time Compensation		Used for Smith's dead time compensation PID control.	
Accumulator for instantaneous value input		Accumulates analog signals, and outputs 8-digit accumulated value signals.	
Run Time Accumulator		Accumulates the operating time, and outputs the pulse signal per specified time.	
Time Sequence Data Statistics (See note.)		Records time sequence data from analog signals and calculates statistics, such as averages and standard deviations.	
Ramp Program		Ramp program setter for combining ramps for time and hold values.	
Segment Program		Segment program setter setting the output values with respect to time.	
Segment Program 2		Segment program setting with wait function for setting the output values with respect to time.	

Control Blocks

Type	Block Name	Function
Controller	2-position ON/OFF (See note.)	2-position type ON/OFF controller
	3-position ON/OFF (See note.)	3-position type ON/OFF controller for heating/cooling ON/OFF control
	Basic PID (See note.)	Performs basic PID control.
	Advanced PID (See note.)	Performs advanced PID control for enabling deviation/MV compensation, MV tracking, etc.
	Blended PID	Performs PID control on the cumulative value (cumulative deviation) between the accumulated value PV and accumulated value Remote Set Point.
	Batch Flowrate Capture	Functions to open the valve at a fixed opening until a fixed batch accumulated value is reached.
	Fuzzy Logic	Outputs up to 2 analog outputs based on fuzzy logic performed on up to 8 analog inputs.
	Indication and Setting (See note.)	Manual setter with PV indication and SP setting functions
	Indication and Operation (See note.)	Manual setter with PV indication and MV setting functions
	Ratio Setting (See note.)	Ratio and bias setter with PV indication and ratio setting function
Indicator (See note.)	PV indicator with PV alarm	

Note: The Function Blocks dealing with high-speed operation (operation cycle: 0.01, 0.02, and 0.05 seconds is possible).

List of Function Blocks

Type	Block Name	Function
Signal Selection/Switching	Rank Selector (See note.)	Selects the rank of up to 8 analog signals.
	Input Selector (See note.)	Selects the specified analog signals specified by the contact signal from up to 8 analog signals.
	3-input Selector (See note.)	Selects and outputs one of three analog input signals.
	3-output Selector (See note.)	Outputs one analog input signal in three switched directions.
	Constant Selector (See note.)	Selects 8 preset constants by the contact signal.
	Constant Generator (See note.)	Outputs 8 independent constants.
	Ramped Switch	Switches two analog inputs (or constants) with a ramp.
	Bank Selector	Records the PID parameters (SP, P, I, D, MH, ML) in up to 8 sets in advance, and switches the PID parameter for Basic/Advanced/Blended PID Blocks according to the analog input range (zone) or input bits.
Constant ITEM Setting	Split Converter	Inputs the MV from the Basic PID block or Advanced PID block, converts the MV into two analog outputs for V characteristics or parallel characteristics (e.g., MV for heating or cooling) and outputs them.
	Constant ITEM Setting (See note.)	Writes the constant to the specified ITEM at the rising edge of the send command contact.
	Variable ITEM Setting (See note.)	Writes the analog signal to the specified ITEM at the rising edge of the send command contact.
	Batch Data Collector (See note.)	Stores each of max. 8 analog inputs to buffer by a certain timing within sequential processing.
Pulse Train Operation	Accumulated Value Input Adder	Adds up to four accumulated value signals.
	Accumulated Value Analog Multiplier	Multiplies analog signals by the accumulated value signals.
	Accumulator for accumulated value input	Converts 4-digit accumulated value signals to 8 digits.
	Contact input/Accumulated value output	Counts low-speed contact pulses, and outputs 8-digit accumulated signals.
Others	Accumulated Value Input/Contact Output	Converts 4-digit accumulated value signals to low-speed contact pulses before they are output.
	Analog/Pulse Width Converter (See note.)	Changes the ON/OFF duration ratio in a constant cycle duration so that it is proportional to the analog signal.
Sequence Operation	Contact Distributor	Connect contact signals between function blocks in a 1:1 connection.
	Constant Comparator (See note.)	Compares up to eight sets of analog signals and constants, and outputs the comparison results as contacts.
	Variable Comparator (See note.)	Compares up to eight pairs of analog signals, and outputs the comparison results as contacts.
	Timer (See note.)	2-stage output type addition timer for forecast values and reached values. Can also output the present value.
	ON/OFF Timer (See note.)	Timer for performing ON-OFF operation at preset ON and OFF times.
	Clock Pulse (See note.)	Outputs a clock pulse at the setting time interval for a single operation cycle.
	Counter (See note.)	2-stage output type addition timer for forecast values and arrival values. Can also output the current value.
	Internal Switch (See note.)	Temporary storage contact for accepting relays in the Step Ladder Program block. Note: (One internal switch is already allocated as "temporary storage" in CX-Process Tool.)
Contact Type Control Target	Level Check (See note.)	Checks an analog input for 8 levels and outputs a contact corresponding to the level. The level number is also output as an analog value at the same time.
	ON/OFF Valve Manipulator	Manipulates and monitors ON/OFF valves with open/close limit switches.
	Motor Manipulator	Manipulates and monitors motor operation.
	Reversible Motor Manipulator	Manipulates and monitors reversible motor operation.
	Motor Opening Manipulator	Inputs a target opening, and manipulates an electric positional-proportional motor.

Note: The Function Blocks dealing with high-speed operation (operation cycle: 0.01, 0.02, and 0.05 seconds is possible).

Sequence Control

Type	Block Name	Function
---	Step Ladder Program (See note.)	Performs logic sequence and step progression control.

Field Terminals

Type	Block Name	Function
Contact I/O (See note.)	DI 8-point Terminal	Inputs 8 contacts from 8-point Input Unit.
	DI 16-point Terminal	Inputs 16 contacts from 16-point Input Unit.
	DI 32-point Terminal	Inputs 32 contacts from 32-point Input Unit.
	DI 64-point Terminal	Inputs 64 contacts from 64-point Input Unit.
	DO 8-point Terminal	Outputs 8 contacts from 8-point Output Unit.
	DO 16-point Terminal	Outputs 16 contacts from 16-point Output Unit.
	DO 32-point Terminal	Outputs 32 contacts from 32-point Output Unit.
	DO 64-point Terminal	Outputs 64 contacts from 64-point Output Unit.
Analog I/O (See note.)	DI 16-point/DO 16-point Terminal	Inputs and outputs 16 contacts each from 16-point Input/16-point Output Units.
	AI 4-point Terminal (PTS51)	Inputs 4 analog signals from CJ1W-PTS51 (Isolated-type Thermocouple Input Unit)
	AI 4-point Terminal (PTS52)	Inputs 4 analog signals from CJ1W-PTS52 (Isolated-type Temperature Resistance Input Unit).
	AI 2-point Terminal (PTS15/16, PDC15)	Inputs 2 analog signals from CJ1W-PTS15 (Isolated-type Thermocouple Input Unit), CJ1W-PTS16 (Isolated-type Temperature Resistance Input Unit), or CJ1W-PDC15 (Isolated-type DC Input Unit).
	AI 8-point Terminal (AD081)	Inputs 8 analog signals from the CJ1W-AD081(-V1).
	AO 8-point Terminal (DA08V/C)	Outputs 8 analog signals from the CJ1W-DA08V/DA08C.
	AI 4-point Terminal (AD041)	Inputs 4 analog signals from the CJ1W-AD041(-V1).
	AO 4-point Terminal (DA041)	Outputs 4 analog signals from the CJ1W-DA041(-V1).
	AO 2-point Terminal (DA021)	Outputs 4 analog signals from the CJ1W-DA021.
	AI 4-point/AO 2-point Terminal (MAD42)	Inputs 4 analog signals and outputs 2 analog signals each from the CJ1W-MAD42.
	AI 4-point Terminal (DRT1-AD04)	Inputs 4 analog signals from a DRT1-AD04 DeviceNet Slave Analog Input Unit.
	AO 2-point Terminal (DRT1-DA02)	Outputs two analog signals from a DRT1-DA02 DeviceNet Slave Analog Output Unit.

CX-Process Tool and Monitor

Software Specifications

Item		Specifications	
		CX-Process Tool	CX-Process Monitor Plus
Name		CX-Process	CX-Process Monitor Plus
Model number		WS02-LCTC1-EV5	WS02-LCMC1-E
Applicable PLCs		CS-series PLCs CJ-series PLCs	
Applicable Units		CJ-series Loop-control CPU Units CS-series Loop Control Units/Boards CS1D Process-control CPU Units	CJ-series Loop-control CPU Units CS-series Loop Control Units/Boards CS1D Process-control CPU Units
Compatible computers	Computer	IBM PC/AT or compatible	
	CPU	Minimum: Pentium 133 MHz min. Recommended: Celeron 400 MHz min.	
	OS	Microsoft Windows 2000 (Service Pack 3 or higher), NT4.0 (Service Pack 6a), 98SE, Me (See note 2), or XP	Microsoft Windows 2000, NT4.0 or XP
	Memory	Minimum: 32 Mbytes Recommended: 64 Mbytes min.	Minimum: 96 Mbytes Recommended: 128 Mbytes min.
	Hard disk storage	Minimum: 50 Mbytes free space Recommended: 100 Mbytes min. free space	Minimum: 400 Mbytes free space Recommended: 500 Mbytes min. free space
	Monitor	Minimum: XGA Recommended: SXGA 65,536 colors or more	Minimum requirement: XGA (XGA or above recommended)
	CD-ROM drive	1 drive min.	
	Sound board	---	1
	Mouse	Recommended: Microsoft mouse or compatible pointing device	
Communications method	Connection with CPU Unit (or Serial Communications Board/Unit)	When FinsGateway Serial Unit driver is used: Communications protocol with PLC: Host Link Host Link (Peripheral Bus is not supported.) (See note 3.) • Connect the computer to the peripheral port or built-in RS-232C port of the CPU Unit, or to the RS-232C port of the Serial Communications Board/Unit. • Connecting cable: For connecting to peripheral port of CPU Unit: CS1W-CN□□□□ (2 m or 6 m) For connecting to RS-232C port of CPU Unit: XW2Z-□□□□-□ (2 m or 5 m)	
		When CX-Server is used: Communications protocol with PLC: Host Link or Peripheral Bus Connecting Cable: • For connecting to peripheral port of CPU Unit: CS1W-CN□□□□ (2 m or 6 m) For connecting to RS-232C port of CPU Unit: XW2Z-□□□□-□ (2 m or 5 m)	CX-Server is not supported.
	Connection via Controller Link	When FinsGateway Controller Link driver or CX-Server is used: Install the software in a computer with a Controller Link Support Board to communicate with a PLC with a Controller Link Unit mounted.	
	Connection via Ethernet	When FinsGateway ETN_UNIT driver or CX-Server is used: Install the software in a computer with an Ethernet Board to communicate with a PLC with an Ethernet Unit mounted.	

Item	Specifications	
Offline functions	ITEM data settings for function blocks <ul style="list-style-type: none"> • Software connections for analog signals • Displaying and printing text strings (annotation) pasted on function block diagrams and ladder diagrams. • Instructions for step ladder blocks and commands for sequence table blocks • Tag settings for CX-Process Monitor 	Construction of user screens
Online functions	<ul style="list-style-type: none"> • Transfer of function block data (Downloading/Uploading for Loop Control Boards/Units.) • Starting/stopping all function blocks (LCU/LCB) • Monitoring system operation: Monitoring and controlling the System Common block (including LCB/LCU load rates) • Validating LCB/LCU operation: Checking function block connections (including starting and starting individual function blocks), validating ladder diagrams and sequence tables, and monitoring ITEMs • Tuning PID constants and other parameters (fine tuning and autotuning) • Initialization of Loop Control Unit memory (RAM) 	User screens <ul style="list-style-type: none"> • Overview screen • Control screen • Tuning screen • Trend screen • Graphic screen • Operating guide message screen System screens <ul style="list-style-type: none"> • Alarm history screen • System monitor screen • Operation log screen

- Note:** 1. The CX-Process functions that can be used depend on the version. For details, refer to the operation manuals (Cat. No.: W372-E1-□ and W373-E1-□).
2. When using Windows Me, the CPU must be a Pentium 150 MHz or higher.
3. Peripheral Bus cannot be used when FinsGateway V3 is used.

Connections to PLC

The following 4 methods can be used to connect to a PLC.

Communications network		Communication driver		
		FinsGateway V3	FinsGateway Version 2003 (See note 1.)	CX-Server V2.2
Host Link	Connection via PLC's peripheral port or RS-232C port	Supported (Serial Unit version is used.)		Supported (See note 2.)
Peripheral Bus		Not supported	Supported	Supported (See note 2.)
Controller Link	Connection to PLC with Controller Link Unit via Controller Link Support Board (PCI board).	Supported (See note 3.) (CLK (PCI) version is used.)		Supported
	Connection to PLC with Controller Link Unit via Controller Link Support Board (ISA board).	Supported (CLK (ISA) version is used.)		Supported
Ethernet	Connection to PLC with Ethernet Unit via Ethernet Board.	Supported (Ethernet version is used.)		Supported

- Note:** 1. The Windows 2000 and XP operating systems are supported. (Windows 95, 98, and Me are not supported.)
2. When CX-Server is used for communications, CX-Programmer can be simultaneously connected via the same COM port.
3. The Windows 95 operating system cannot be used.

Utility Software

Touch Panel Software

■ Face Plate Auto-Builder for NS

Simply specify the CSV tag file created using the CX-Process Tool to automatically create a project constructed with a Face Plate for Loop-control CPU Units for use with OMRON's NS-series Programmable Terminals.


Function Overview

- Create windows for monitoring and tuning PID and other function blocks for up to 100 loops (NS System version 4 or higher).
- NS project files for monitoring multiple Loop-control CPU Units from a single NS-series PT can be generated from CX-Process projects for up to 32 multiple nodes.
- When a Segment Program 2 function block is used for program operation, the Detailed Setting Windows (Time Interval vs. Output Value Setting Window, Wait Interval Setting Window) used for the parameter settings are also automatically generated.

Basic Specifications

Item	Specifications	
Name	Face Plate Auto-Builder for NS	
Model number	WS02-NSFC1-EV2	
Applicable PLC products	CJ-series Loop-control CPU Units CS-series Loop Control Boards (unit version 1.0 or later) CS-series Loop Control Units (unit version 2.0 or later) CS1D Process-control CPU Units	
Applicable PTs	NS-series NS12, NS10, and NS8 (PT version 2.0 or later) CX-Designer	
System requirements	Computer	IBM PC/AT or compatible
	CPU	Celeron 400 MHz or better recommended
	OS	Microsoft Windows 95 (see note.), 98, Me, NT4.0, 2000, or XP
	Memory	Recommended: 32 Mbytes min.
	Hard disk storage	Recommended: 200 Mbytes free space min.
	Monitor	Minimum: 640 x 480 dots
Basic functions	Number of generated loops: 100 max., control windows and tuning windows Applicable face plates: 2-position ON/OFF, 3-position ON/OFF, Basic PID, Advanced PID, Indication and Operation, Indicator, Segment Program 2 (includes the parameter setting windows) Number of loops in control windows: 6 loops per window for NS12, 4 loops per window for NS10/NS8 Realtime trend in tuning window: 1-second cycle	

Example of Automatically Created Windows

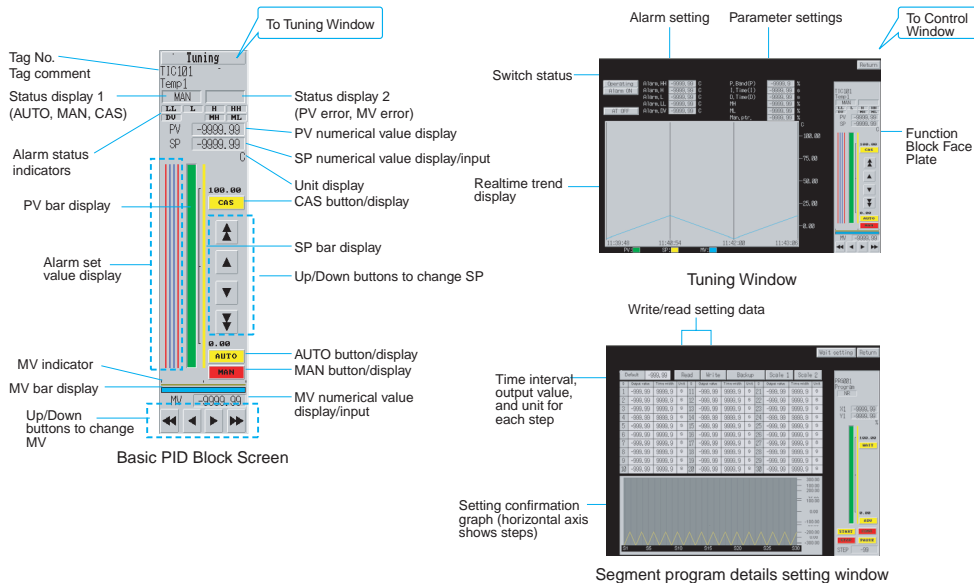

Dimensions




Dimensions

CPU Units


Loop-control CPU Units

- CJ1G-CPU42P
- CJ1G-CPU43P
- CJ1G-CPU44P
- CJ1G-CPU45P

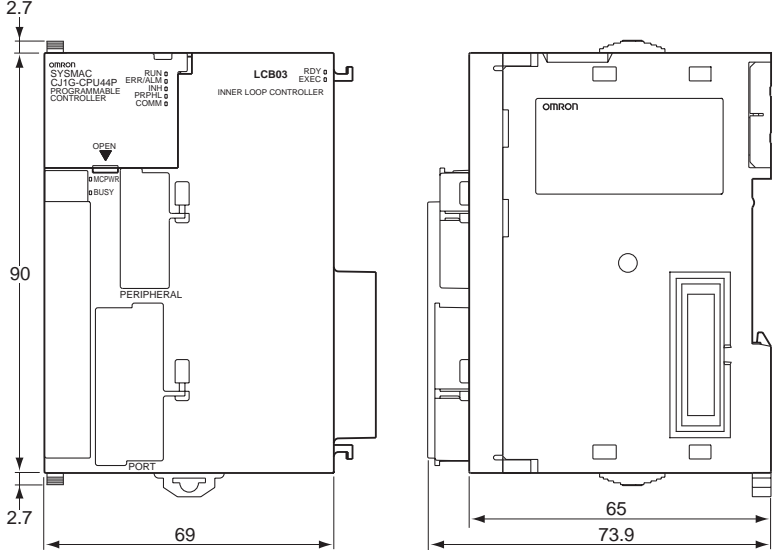

Process Input Units

- CJ1W-P□□□□

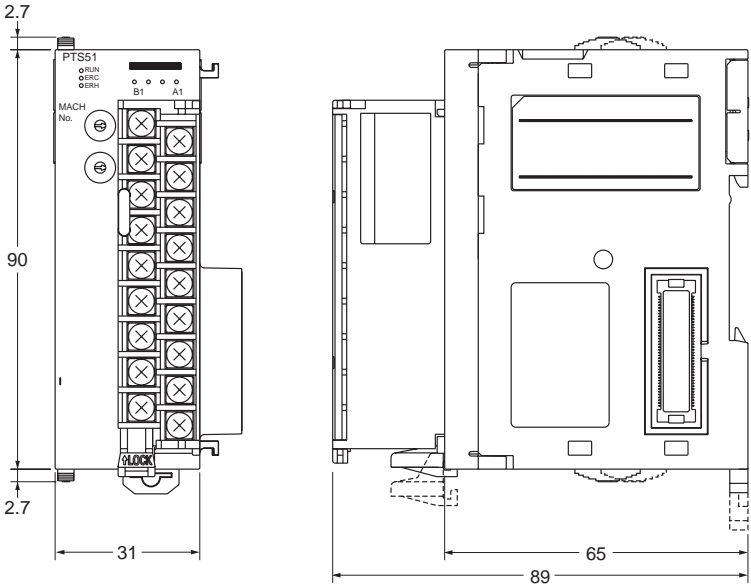

Ordering Information

Basic Configuration Units

Name	Specifications					Model	Standards	
Loop-control CPU Unit	I/O bits	Program capacity	Data memory capacity	LD instruction execution time	Number of function blocks	---	---	
	1,280 (3 Expansion Racks)	60 Ksteps	128 K words (DM: 32K words, EM: 32 K words × 3 banks)	0.04 μs	300 blocks	CJ1G-CPU45P	UC1, CE, N	
		30 Ksteps	64 K words (DM: 32K words, EM: 32 K words × 1 bank)			CJ1G-CPU44P		
	960 (2 Expansion Racks)	20 Ksteps	64 K words (DM: 32K words, EM: 32 K words × 1 bank)	50 blocks	CJ1G-CPU43P			
10 Ksteps		CJ1G-CPU42P						
CPU Units (without Loop Control Engine)	I/O bits	Program capacity	Data memory capacity	LD instruction execution time	Built-in I/O	---	---	
	2,560 (3 Expansion Racks)	250 Ksteps	448 K words (DM: 32K words, EM: 32 K words × 13 banks)	0.02 μs	---	CJ1H-CPU67H	UC1, CE, N, L	
		120 Ksteps	256 K words (DM: 32K words, EM: 32K words × 7 banks)			CJ1H-CPU66H		
		60 Ksteps	128 K words (DM: 32K words, EM: 32K words × 3 banks)			CJ1H-CPU65H		
	1,280 (3 Expansion Racks)	30 Ksteps	64 K words (DM: 32K words, EM: 32K words × 1 bank)	0.04 μs	---	CJ1G-CPU45H		
		20 Ksteps	64 K words (DM: 32K words, EM: 32K words × 1 bank)			CJ1G-CPU44H		
	960 (2 Expansion Racks)	10 Ksteps		32 K words (DM: 32K words, no EM)	0.1 μs	---		CJ1G-CPU43H
		10 Ksteps	CJ1G-CPU42H					
	640 (1 Expansion Rack)	20 Ksteps	32 K words (DM: 32K words, no EM)	0.1 μs	---	CJ1M-CPU13		
	320 (no expansion)	10 Ksteps				CJ1M-CPU12		
	160 (no expansion)	5 Ksteps	10 inputs and 6 outputs	---	CJ1M-CPU11			
	640 (1 Expansion Rack)	20 Ksteps			CJ1M-CPU23 (See note 1.)			
	320 (no expansion)	10 Ksteps			CJ1M-CPU22 (See note 1.)			
	160 (no expansion)	5 Ksteps			CJ1M-CPU21 (See note 1.)			
Power Supply Units						CJ1W-PA205R		
100 to 240 V AC (with RUN output), Output capacity: 5 A, 5 V DC						CJ1W-PA202		
100 to 240 V AC, Output capacity: 2.8 A, 5 V DC						CJ1W-PD025		
24 V DC, Output capacity: 5 A, 5 V DC						CJ1W-CIF11		
RS-422A Adapter	Converts RS-232C to RS-422A/RS-485.							
I/O Control Unit	Mount 1 Unit on the CJ-series CPU Rack when connecting a CJ-series Expansion Rack.					CJ1W-IC101		
I/O Interface Unit	1 required on each CJ-series Expansion Rack					CJ1W-II101		
I/O Connecting Cable	For connecting CJ-series Expansion Racks to the CJ-series CPU Rack or another CJ-series Expansion Rack.			Cable length: 0.3 m	CS1W-CN313	L, CE		
				Cable length: 0.7 m	CS1W-CN713			
				Cable length: 2 m	CS1W-CN223			
				Cable length: 3 m	CS1W-CN323			
				Cable length: 5 m	CS1W-CN523			
				Cable length: 10 m	CS1W-CN133			
				Cable length: 12 m	CS1W-CN133-B2			
Memory Cards	Flash memory, 30 MB					HMC-EF372 (See note 2.)		
	Flash memory, 64 MB					HMC-EF672 (See note 2.)		
	Memory Card Adapter (for computer PCMCIA slot)					HMC-AP001	CE	

- Note:** 1. The CJ1M-CPU23/22's connector for built-in I/O is not included. Purchase one of the connectors in the following table separately.
 2. The HMC-EF172, HMC-EF372, and HMC-EF672 Memory Cards cannot be used with the following products. The following CPU Units with lot numbers of 020108 or earlier (manufactured 8 January 2002 or earlier): CS1G-CPU□□H, CS1H-CPU□□H, CJ1G-CPU□□H, and CJ1H-CPU□□H, and NS7-series PTs with lot numbers of 0852 or earlier (manufactured 8 May 2002 or earlier).

Programming Devices

Name		Specifications	Model	Standards	
Programming Consoles		An English Keyboard sheet (CS1W-KS001-E) is required. Note: Connects to peripheral port on CPU Unit only (cannot be connected to RS-232C port).	CQM1H-PRO01-E	U, C, CE	
			CQM1-PRO01-E	U, C, N, CE	
			C200H-PRO27-E		
Programming Console Key Sheet		For CQM1H-PRO01-E, CQM1-PRO01-E, and C200H-PRO27-E	CS1W-KS001-E	CE	
Programming Console Connecting Cables		Connects the CQM1-PRO01-E Programming Console. (Length: 0.05 m)	CS1W-CN114		
		Connects the C200H-PRO27-E Programming Console. (Length: 2.0 m)	CS1W-CN224		
		Connects the C200H-PRO27-E Programming Console. (Length: 6.0 m)	CS1W-CN624		
CX-One Integrated Tool Package Ver. 1.1	1 license	CX-One is a package that integrates Support Software for OMRON PLCs and components. It can be run in a Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later) or XP environment. CX-One includes CX-Programmer Ver. 6.□, CX-Simulator Ver. 1.□, CX-Protocol Ver. 1.□, CX-Process Tool Ver. 5.□, CX-Designer Ver. 1.□, and NS-series Face Plate Auto Builder Ver. 2.□. Refer to the CX-One catalog (R134) for details. (See note.)	CXONE-AL01C-E	---	
	3 license		CXONE-AL03C-E		
	10 licenses		CXONE-AL10C-E		
	30 licenses		CXONE-AL30C-E		
	50 licenses		CXONE-AL50C-E		
	The CX-Programmer, CX-Simulator, CX-Protocol, CX-Process Tool, CX-Designer, and NS-series Face Plate Auto Builder can still be ordered separately, using the following model numbers as before.				
CX-Programmer Ver. 6.□	1 license	Windows-based Support Software	WS02-CXPC1-E-V6□	---	
	3 licenses	OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP	WS02-CXPC1-EL03-V6□		
	10 licenses		WS02-CXPC1-EL10-V6□		
CX-Process Tool Ver. 5.□	1 license	Support Software for loop control OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP	WS02-LCTC1-EV5	---	
CX-Simulator Ver. 1.□	1 license	Support Software for simulation of ladder program operation OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP	WS02-SIMC1-E	---	
CX-Protocol Ver. 1.□	1 license	Support Software for creating protocol macros Use with CJ1G/CJ1H Ver. 1.2 or later, or CJ1M Ver. 1.3 or later. OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP	WS02-PSTC1-E	---	
CX-Designer Ver. 1.□	1 license	NS-series PT screen design software OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP CX-Designer Ver. 1.0 includes Ladder Monitor software. Note: Ladder Monitor software is NS-series PT software for monitoring ladder programs in CS/CJ-series PLCs. To use it, a Memory Card and Memory Card Adaptor must be ordered separately.	NS-CXDC1-V1	---	
NS-series Face Plate Auto Builder Ver. 2.□	1 license	NS-series PT software for automatic generation of screen data OS: Windows 98SE, Me, NT 4.0 (Service Pack 6a), 2000 (Service Pack 3 or later), or XP	WS02-NSFC1-EV2	---	
CX-Process Monitor Plus	1 license	Loop control monitoring software for Windows NT4.0, 2000, or XP.	WS02-LCMC1-E	---	
	3 licenses		WS02-LCMC1-EL03		
	10 licenses		WS02-LCMC1-EL10		
Peripheral Device Connecting Cables (for peripheral port)		Connects DOS computers, D-Sub 9-pin receptacle (Length: 0.1 m)	Note: Conversion cable to connect RS-232C cable to peripheral port	CE	
		Connects DOS computers, D-Sub 9-pin (Length: 2.0 m)			CS1W-CN226
		Connects DOS computers, D-Sub 9-pin (Length: 6.0 m)			CS1W-CN626

Note: Site licenses are also available for users that need to use the CX-One on many computers. Ask your OMRON representative for details.

Ordering Information

Name	Specifications	Model	Standards	
Peripheral Device Connecting Cables (for RS-232C port)	Connects DOS computers, D-Sub 9-pin (Length: 2.0 m)	XW2Z-200S-CV	---	
	Connects DOS computers, D-Sub 9-pin (Length: 5.0 m)			XW2Z-500S-CV
	Connects DOS computers, D-Sub 9-pin (Length: 2.0 m)	XW2Z-200S-V		---
	Connects DOS computers, D-Sub 9-pin (Length: 5.0 m)			
USB-Serial Conversion Cable	USB-to-RS-232C Conversion Cable (Length: 0.5 m) and PC driver (on CD-ROM), Complies with USB Specification 1.1 On personal computer end: USB (A plug connector, male) On PLC end: RS-232C (D-sub 9-pin, male) Driver: Provided for Windows 98, Me, 2000, and XP	CS1W-CIF31		

Basic I/O Units

Classification	Name	Specifications	Model	Standards	
Input Units	DC Input Units	12 to 24 VDC, 8 inputs, 10 mA	CJ1W-ID201	UC, CE, N, L	
		24 V DC, 16 inputs, 7 mA	CJ1W-ID211		
		24 V DC, 32 inputs, 4.1 mA (Fujitsu-compatible connector)	CJ1W-ID231 (See note 1.)		
		24 V DC, 32 inputs, 4.1 mA (MIL connector)	CJ1W-ID232 (See note 1.)		
		24 V DC, 64 inputs, 4.1 mA (Fujitsu-compatible connector)	CJ1W-ID261 (See note 1.)		
		24 V DC, 64 inputs, 4.1 mA (MIL connector)	CJ1W-ID262 (See note 1.)		
	AC Input Units	100 to 120 V AC, 7 mA (100 V, 50 Hz), 16 inputs, terminal block	CJ1W-IA111		
	200 to 240 V AC, 10 mA (200 V, 50 Hz), 8 inputs, terminal block	CJ1W-IA201			
	Interrupt Input Unit	24 VDC, 7 mA, 16 inputs, terminal block	CJ1W-INT01		
	High-speed Input Unit	24 VDC, 7 mA, 16 inputs, terminal block	CJ1W-IDP01		
Output Units	Relay Bit Output Units	250 V AC/24 V DC, 2 A, independent contacts, 8 outputs max.	CJ1W-OC201		
		250 V AC/24 V DC, 2 A, independent contacts, 16 outputs max.	CJ1W-OC211		
	Transistor Output Units	250 V AC/24 V DC, 2 A, independent contacts, 8 outputs max.	CJ1W-OD201		
		24 V DC, 2 A, 8 outputs, sourcing, load short-circuit protection, alarm, terminal block	CJ1W-OD202		
		12 to 24 V DC, 0.5 A, 8 outputs, sinking, terminal block	CJ1W-OD203		
		24 V DC, 0.5 A, 8 outputs, sourcing, load short-circuit protection, alarm, terminal block	CJ1W-OD204		
		12 to 24 V DC, 0.5 A, 16 outputs, sinking, terminal block	CJ1W-OD211		
		24 V DC, 0.5 A, 16 outputs, sourcing, load short-circuit protection, disconnection detection, alarm, terminal block	CJ1W-OD212		
		12 to 24 V DC, 0.5 A, 32 outputs, sinking, Fujitsu-compatible connector	CJ1W-OD231 (See note 1.)		
		24 VDC, 0.5 A, 32 outputs, sourcing, load short-circuit protection, alarm, MIL connector	CJ1W-OD232 (See note 1.)		
		12 to 24 VDC, 0.5 A, 32 outputs, sinking, MIL connector	CJ1W-OD233 (See note 1.)		
		12 to 24 VDC, 0.3 A, 64 outputs, sinking, Fujitsu-compatible connector	CJ1W-OD261 (See note 1.)		
		24 VDC, 0.3 A, 64 outputs, sourcing, MIL connector	CJ1W-OD262 (See note 1.)		
		12 to 24 VDC, 0.3 A, 64 outputs, sinking, MIL connector	CJ1W-OD263 (See note 1.)		
		Triac Output	Unit 250 VAC, 0.6 A, 8 outputs, terminal block	CJ1W-OA201	
I/O Units	DC Input/Transistor Output Units	16 inputs, 24 V DC, 7 mA	Fujitsu-compatible connector	UC1, CE, N	
		16 outputs, 12 to 24 V DC, 0.5 A, sinking outputs			CJ1W-MD231 (See note 2.)
		16 inputs, 24 V DC, 7 mA	MIL connector		CJ1W-MD232 (See note 2.)
		16 outputs, 24 V DC, 0.5 A, sourcing outputs, load short-circuit protection, alarm			CJ1W-MD233 (See note 2.)
		16 inputs, 24 V DC, 7 mA	MIL connector		CJ1W-MD261 (See note 1.)
		16 outputs, 12 to 24 V DC, 0.5 A, sinking outputs			CJ1W-MD263 (See note 1.)
		32 inputs, 24 V DC, 4.1 mA	Fujitsu-compatible connector		CJ1W-MD261 (See note 1.)
		32 outputs, 12 to 24 V DC, 0.3 A, sinking outputs			CJ1W-MD263 (See note 1.)
	32 inputs, 24 V DC, 4.1 mA	MIL connector	CJ1W-MD263 (See note 1.)		
	32 outputs, 12 to 24 V DC, 0.3 A, sinking outputs		CJ1W-MD563 (See note 1.)		
TTL I/O Unit	32 inputs, 5 V DC, 35 mA	MIL connector	CJ1W-MD563 (See note 1.)		
	32 outputs, 5 V DC, 35 mA				

Ordering Information

Classification	Name	Specifications	Model	Standards
B7A Interface Units		64 inputs	CJ1W-B7A14	CE
		64 outputs	CJ1W-B7A04	
		32 inputs/32 outputs	CJ1W-B7A22	

- Note:** 1. Connectors are not provided with these connector models. Either purchase one of the following 40-pin Connectors, or use an OMRON XW2□ Connector-Terminal Block Conversion Unit or a G7□ I/O Relay Terminal.
 2. Connectors are not provided with these connector models. Either purchase one of the following 20-pin or 24-pin Connectors, or use an OMRON XW2□ Connector-Terminal Block Conversion Unit or a G7□ I/O Relay Terminal.

This eco label is displayed only on products that satisfy stringent environmental standards established by OMRON.



This ECO label is indicated on products that meet the environmental standards established by OMRON.

Special I/O Units

Type	Name	Specifications	Model	Standards
Special I/O Units	Analog Input Units	8 inputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V, 4 to 20 mA) Resolution: 1/8000, Conversion speed: 250 μs/point max. (Settable to 1/4000 and 1 ms/point.)	CJ1W-AD081-V1	UC1, CE, N, L
		4 inputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V, 4 to 20 mA) Resolution: 1/8000, Conversion speed: 250 μs/point max. (Settable to 1/4000 and 1 ms/point.)	CJ1W-AD041-V1	
	Analog Output Units	8 outputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V) Resolution: 1/4000, Conversion speed: 1 ms/point max. (Settable to 1/8000, 250 μs/point)	CJ1W-DA08V	UC1, CE, N, L
		8 outputs (4 to 20 mA) Resolution: 1/4000, Conversion speed: 1 ms/point max. Settable to 1/8000, 250 μs/point)	CJ1W-DA08C	
		4 outputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V, 4 to 20 mA) Resolution: 1/4,000, Conversion speed: 1 ms/point max.	CJ1W-DA041	
		2 outputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V, 4 to 20 mA) Resolution: 1/4000, Conversion speed: 1 ms/point max.	CJ1W-DA021	
	Analog I/O Units	4 inputs, 2 outputs (1 to 5 V, 0 to 5 V, 0 to 10 V, -10 to 10 V, 4 to 20 mA) Resolution: 1/4000, Conversion speed: 1 ms/point max. (Settable to 1/8000, 250 μs/point)	CJ1W-MAD42	UC1, CE
	Process Input Units (High Resolution Models)	2 inputs, B, E, J, K, L, N, R, S, T, U; WRe5-26; PL II; ±100 mV Resolution: 1/64,000; Conversion speed: 10 ms/Unit	CJ1W-PTS15 NEW	
		2 inputs, Pt 100 Ω (JES, IEC), JPt 100 Ω, Pt 50 Ω, Ni 508 Ω Resolution: 1/64,000; Conversion speed: 10 ms/Unit	CJ1W-PTS16 NEW	
		2 inputs, 0 to 100 V, ±10 V, 0 to 5 V, ±5 V, 0 to 1.25 V, ±1.25 V Resolution: 1/64,000; Conversion speed: 10 ms/Unit	CJ1W-PDC15 NEW	
	Process Input Units (Economy Models)	4 inputs, R, S, K, J, T, L, B; Conversion speed: 250 ms/4 inputs	CJ1W-PTS51	UC1, CE, N, L
		4 inputs, Pt 100 Ω (JIS, IEC), JPt100 Ω, Conversion speed: 250 ms/4 inputs	CJ1W-PTS52	
	Temperature Control Units	4 loops, thermocouple input, NPN output	CJ1W-TC001	UC1, CE, N, L
		4 loops, thermocouple input, PNP output	CJ1W-TC002	
		2 loops, thermocouple input, NPN output, heater burnout detection function	CJ1W-TC003	
		2 loops, thermocouple input, PNP output, heater burnout detection function	CJ1W-TC004	
		4 loops, platinum resistance thermometer input, NPN output	CJ1W-TC101	
		4 loops, platinum resistance thermometer input, PNP output	CJ1W-TC102	
		2 loops, platinum resistance thermometer input, NPN output, heater burnout detection function	CJ1W-TC103	
		2 loops, platinum resistance thermometer input, PNP output, heater burnout detection function	CJ1W-TC104	
	High-speed Counter Unit	2 inputs, max. input frequency: 500 kpps	CJ1W-CT021	---
	CompoBus/S Master Unit	CompoBus/S remote I/O, 256 points max.	CJ1W-SRM21	
	ID Sensor Units (See note.)	For V600 Series, 1 R/W Head	CJ1W-V600C11	
For V600 Series, 2 R/W Heads		CJ1W-V600C12		

Note: Refer to the *FA System Devices Group Catalog* for details on the V600 Series RFID System.

CPU Bus Units

Type	Name	Specifications	Model	Standards
CPU Bus Units	Controller Link Units	Wired (Shielded twisted-pair cable)	CJ1W-CLK21-V1	UC1, CE, N, L
	Controller Link Relay Terminal	Wired Includes 5 Terminals	CJ1W-TB101	---
	Controller Link Support Board	Twisted pair, PCI bus (wired), with Support Software	3G8F7-CLK21-EV1	CE
	Controller Link Repeater Units	Wired-wired type	CS1W-RPT01	UC1, CE
		Wired-optical (H-PCF) type	CS1W-RPT02	
		Wired-optical (GI) type	CS1W-RPT03	
	Serial Communications Units	1 RS-232C port and 1 RS-422/485 port	CJ1W-SCU41-V1	UC1, CE, N, L
		2 RS-232C ports	CJ1W-SCU21-V1	
	Ethernet Units	10Base-T	CJ1W-ETN11	UC1, CE, N, L
		100Base-TX	CJ1W-ETN21	
	FL-net Unit	100Base-TX	CJ1W-FLN22	UC1, CE
	DeviceNet Unit	Functions as master and/or slave; allows control of 32,000 points max. per master.	CJ1W-DRM21	UC1, CE, N, L
Position Control Unit	Equipped with MECHATROLINK-II, multiple axis control for 16 axes max.	CJ1W-NCF71	---	

NS-series Programmable Terminals

Model name	Specifications	Specifications		Model number	Standards
		Ethernet	Case color		
NS12	12-inch TFT, 800 × 600 dots	No	Ivory	NS12-TS00-V2	CU, CE
			Black	NS12-TS00B-V2	
		Yes	Ivory	NS12-TS01-V2	
			Black	NS12-TS01B-V2	
NS10	10-inch TFT, 640 × 480 dots	No	Ivory	NS10-TV00-V2	
			Black	NS10-TV00B-V2	
		Yes	Ivory	NS10-TV01-V2	
			Black	NS10-TV01B-V2	
NS8	8-inch TFT, 640 × 480 dots	No	Ivory	NS8-TV00-V2	
			Black	NS8-TV00B-V2	
		Yes	Ivory	NS8-TV01-V2	
			Black	NS8-TV01B-V2	
NS5	5-inch STN, 320 × 240 dots	No	Ivory	NS5-SQ00-V2	
			Black	NS5-SQ00B-V2	
		Yes	Ivory	NS5-SQ01-V2	
			Black	NS5-SQ01B-V2	
	5-inch TFT, 320 × 240 dots	No	Ivory	NS5-TQ00-V2	
			Black	NS5-TQ00B-V2	
		Yes	Ivory	NS5-TQ01-V2	
			Black	NS5-TQ01B-V2	
	5-inch, monochrome, 320 × 240 dots	No	Ivory	NS5-MQ00-V2	
			Black	NS5-MQ00B-V2	
		Yes	Ivory	NS5-MQ01-V2	
			Black	NS5-MQ01B-V2	
NS5 Hand-held	5-inch STN, 320 × 240 dots	No	Black	NSH5-SQR001B-V2	CE, CU (approval pending)

Ordering Information

Model name	Specifications	Model number
Cable (See note 1.)	Screen transfer cable for DOS/V	XW2Z-S002
	USB Host Cable, cable length: 5 m	NS-US52 (5 m)
	USB Host Cable, cable length: 2 m	NS-US22 (2 m)
	USB-RS-232C Conversion Cable, cable length: 0.5 m	CS1W-CIF31
NSH5 Cables	RS-422A cable (loose wires), Cable length: 10 m	NSH5-422CW-10M
	RS-232C cable (loose wires), Cable length: 3 m	NSH5-232CW-3M
	RS-232C cable (loose wires), Cable length: 10 m	NSH5-232CW-10M
PT-to-PLC Connecting Cable	PT connection: 9 pins	Length: 2 m XW2Z-200T
	PLC connection: 9 pins	Length: 5 m XW2Z-500T
NSH5 Wall-mounting Bracket		NSH5-ATT02

Note: 1. Use an OMRON USB Host Cable to connect an NS-series PT to a printer.

2. Site licenses are also available for users that need to use the CX-One on many computers. Ask your OMRON representative for details.

Options

Model name	Specifications	Model number	
RS-422A Adapter	Transmission distance: 500 m total length Note: Use this model when connecting PT models without a V□ suffix. Note: PT models with a suffix of V□ can also be connected.	NS-AL002	
	Transmission distance: 50 m total length Note: Only PT models with a suffix of V□ are connectable. Use the NS-002 to connect models without a V□ suffix.	CJ1W-CIF11	
Sheet/Cover	Anti-reflection Sheets (5 surface sheets)	NS12/10	NS12-KBA04
		NS8	NS7-KBA04
		NS5	NT30-KBA04
	Protective Covers (5 pack) (anti-reflection coating)	NS12/10	NS12-KBA05
		NS8	NS7-KBA05
		NS5	NT31C-KBA05
	Protective Covers (5 covers included) (Transparent)	NS12/10	NS12-KBA05N
		NS8	NS7-KBA05N
		NS5	NT31C-KBA05N

Ordering Information

International Standards

- The standards indicated in the "Standards" column are those current for UL, CSA, cULus, cUL, NK, and Lloyd standards and EC Directives as of the end of September 2004. The standards are abbreviated as follows: U: UL, UR: UL Recognition Mark, U1: UL Class I Division 2 Products for Hazardous Locations, C: CSA, UC: cULus, UC1: cULus Class I Division 2 Products for Hazardous Locations, CU: cUL, N: NK, L: Lloyd, and CE: EC Directives.
- Ask your OMRON representative for the conditions under which the standards were met.

EMC Directives

Applicable Standards

EMI: EN61000-6-4

EMS: EN61131-2 and EN61000-6-2 (See note.)

PLCs are electrical devices that are incorporated in machines and manufacturing installations. OMRON PLCs conform to the related EMC standards so that the devices and machines into which they are built can more easily conform to EMC standards. The actual PLCs have been checked for conformity to EMC standards. Whether these standards are satisfied for the actual system, however, must be checked by the customer.

EMC-related performance will vary depending on the configuration, wiring, and other conditions of the equipment or control panel in which the PLC is installed. The customer must, therefore, perform final checks to confirm that the overall machine or device conforms to EMC standards.

Note: The applicable EMS standard depends on the product.

Low Voltage Directive

Applicable Standard: EN61131-2

Devices that operate at voltages from 50 to 1,000 V AC or 75 to 150 V DC must satisfy the appropriate safety requirements. With PLCs, this applies to Power Supply Units and I/O Units that operate in these voltage ranges.

These Units have been designed to conform to EN61131-2, which is the applicable standard for PLCs.